

Technical specifications

Three-phase direct connected meters
EWGE31xxx family

<i>Document: version 2.6</i>	<i>Name</i>	<i>Date</i>
<i>Written by</i>	Saša Aleksandrov	16.12.2024.
<i>Controlled by</i>	Žarko Ranđelović	17.12.2024.
<i>Approved by</i>	Nenad Nikolić	18.12.2024.

<i>Document: version 2.6</i>	<i>List of changes</i>	<i>Date</i>
	Electrical test output – SO: optional	11.10.2019.
	Meter type label changed to EWG E 31x Nx ABR20 C0 S	10.11.2021.
	Type approval extension	10.11.2021.
	Alarm registers added in this document	17.11.2021.
	New ARM processor with G0 mark	14.06.2023.
	Meter type label changed to EWG E 31x Nx ABR20 C0 S P	14.06.2023.
	Additional function description	16.12.2024.



Table of Contents

1. Meters introduction	6
1.1. Metrological characteristics of the meters	6
1.1.1. Accuracy class of the meters	6
1.1.2. Metrological parameters of EWGE31x meters family	7
1.1.3. Standards and references	10
2. Design of the meter	11
2.1. Meter housing (construction)	11
2.1.1. Front and bottom view	11
2.1.2. Overall meter housing dimensions	12
2.1.3. Terminal block	12
2.2. Meter labels	16
2.2.1. Name plate	16
2.2.2. OBIS code plate	17
2.2.3. Connection diagram	18
2.3. Additional module case – communication modules	19
2.4. Sealing	19
3. Electronic boards – PCB's	20
3.1. Upper electronic board	20
3.1.1. Signal input pins	21
3.1.2. Analogue front end (AFE)	21
3.1.3. Digital computation engine (CE)	22
3.1.4. 80515 microprocessor core (MPU)	22
3.1.5. ARM microprocessor (core M0)	22
3.1.6. Optical test output	22
3.1.7. Meter buttons	23
3.2. Lower electronic board	23
3.2.1. Power supply	23
3.2.2. Electrical test output (optional)	24
3.2.3. Auxiliary relay	24
3.2.4. Internal supply control switch (option)	24
3.3. Meter communication ports	25
3.3.1. Optical port	25
3.3.2. Electrical communication port	26

3.3.3.	Electrical interface number 3 – HAN.....	26
3.3.4.	Electrical interface number 4 - RS485.....	26
3.4.	Pushing Process.....	27
3.4.1.	Triggering Objects	27
3.5.	COSEM objects for CIP functionality using PUSH operation (option).....	28
4.	LCD - data display procedure	29
4.1.	Display.....	29
4.1.1.	Alphanumeric fields (data value and OBIS code field).....	29
4.1.2.	Physical units field.....	29
4.1.3.	Power flow direction cursors	29
4.1.4.	Phase voltage presence indicator	30
4.1.5.	Tariff and error cursors	30
4.2.	Data Display Procedure.....	30
4.2.1.	Automatic mode	32
4.2.2.	Manual mode	34
4.2.3.	Test mode	37
5.	Additional meter functions	39
5.1.	Profiles of measured and registered values.....	39
5.1.1.	Billing profile	39
5.1.2.	Load profile with recording period 1 – load profile	39
5.1.3.	Load profile with recording period 2 – consumption profile.....	39
5.1.4.	Load profile with recording period 3 - daily register values	40
5.1.5.	Load profile power quality (measured value)	40
5.2.	Events and Event logs	40
5.2.1.	Standard Event Log	41
5.2.2.	Power quality log (sag and swell).....	41
5.2.3.	Integrity violation log	42
5.2.4.	Power failure.....	42
5.2.5.	Disconnect Control Log.....	43
5.2.6.	Communication Log / Event log	44
5.3.	Alarms	44
5.3.1.	Alarm reporting process.....	45
6.	Disconnect control – Load Switching Module.....	46
6.1.	Object disconnect control	47

- 6.1.1. Output State..... 47
- 6.1.2. Control State 47
- 6.1.3. Control Mode 47
- 6.1.4. Method Description 50
- 6.2. Disconnect control scheduler (Class_ID 22)..... 50
- 6.3. Disconnecter script table (Class_ID 9) 50
- 7. Limiter Interface Class (class_id:71) 52
 - 7.1. Limiter in Normal Operation 52
- 8. Tariff control 54
- 9. Software update 55
- 10. Data transfer security 56
- 11. Meter marking 57
- 12. Packaging and Storage 58



1. Meters introduction

EWGE31xxx family consist of the three-phase electronic (static) meters for direct connection in three-phase four wire low voltage grid.

The meters are designed for measuring of the active and reactive energy consumption and maximum power demand for up to four tariffs, instantaneous (RMS) values of the active power, current and voltage.

Meters have build-in real time clock (RTC) and tariff management calendar.

1.1. Metrological characteristics of the meters

Measuring and technical characteristics of the meter comply with EN 50470 – 1 and EN 50470-3 European standards for static active energy meters classes A and B (IEC 62052-11 and IEC 62053-21 international standards for electronic active energy meters, classes 1 and 2), and reactive energy meters classes 2 and 3 in compliance with IEC 62053-23.

1.1.1. Accuracy class of the meters

Table 1.1 Accuracy class

Type of meter	Number of measurement systems	Grid	Relevant standards	Accuracy class
EWGE31xxx	3	3 phase - 4 wire	Active energy EN50470 – 1 and EN50470 – 3	A and B
			Reactive energy IEC62053-23	2 and 3

1.1.2. Metrological parameters of EWGE31x meters family

Meter family		EWGE311xxx	EWGE31xAxRx
Nominal voltage		3x230/400 V	3x230/400 V
Voltage range		0.8U _n – 1.15U _n	0.8U _n – 1.15U _n
Nominal frequency		50 Hz	50 Hz
Nominal (base) current		5(10) A	5(10) A
Maximal current		40 (60, 80) A	40 (60, 80) A
Transient current		0.5 A	
Minimal current		250 mA	
Starting current		25 mA for class 2 (A) 20 mA for class 1 (B)	
Energy direction		import/export	import/export
Power consumption per phase	voltage circuit	< 3W and 15 VA	< 3W and 15 VA
	current circuit	< 2.5 VA for class 2 (A) < 4 VA for class 1 (B)	< 4 VA for class 1 (B)
Number of tariffs		up to 4	up to 4
Pulse output		optical and electrical	optical and electrical
Constant of optical pulse output			
	for active energy	1.000 pulse/kWh	1.000 pulse/kWh
	for reactive energy		1.000 pulse/kVArh
Constant of electrical pulse output			
	for active energy	500 pulse/kWh	500 pulse/kWh
	for reactive energy		500 pulse/kVArh
Characteristic of electrical pulse output according to IEC62052-11 and IEC62053-31		voltage < 27 V, current < 27 mA	
Mechanical class		M1	
Electromagnetic class		E2	
Protective class (electrical)		II	
Operating temperature		-25 °C to +55 °C	
Storage temperature		-40 °C to +80 °C	
Internal real time clock		IEC 62052-21 / EN 62054-21	
Accuracy at 25 °C		< 0.5s/24h	
Backup operation time		> 12 years with Li battery	
Clock signal		Quartz crystal 32.768 kHz	
Communication interfaces			
Optical			
Data transfer rate		300 to 9600 bps	
Interface		IEC62056-21 mode C	
Protocol		IEC62056-46 DLMS/COSEM	
Register marking		IEC62056-61 OBIS	
Serial interface TTL level			
Data transfer rate		300 to 9600 bps	
Protocol		IEC62056-46 DLMS/COSEM	
Register marking		IEC62056-61 OBIS	

PLC modem	
PLC modulation	SFSK / OFDM G3
GSM/GPRS modem - option	
Data transfer rate	53.6 kB/s
Interface	IEC62056-46 DLMS/COSEM
Register marking	IEC62056-61 OBIS
NBLoT modem - option	
Other communication interfaces	
Average power demand	
Integration period - programmable	1, 5, 15, 30, 60 minutes (default 15 minutes)
Reset	no external reset (software only)
EMC according to IEC 62052-11	
Dielectric strength IEC60060-1	4 kV, 50 Hz, 1 min.
Electrostatic discharge IEC61000-4-2	contact 8 kV, air 15 kV
Electromagnetic fields IEC61000-4-3 (§7.4.6)	10V/m – load 30V/m - no load
Burst test IEC61000-4-4 (§7.4.7)	main terminals – 4 kV auxiliary terminals – 2 kV
Surge test IEC61000-4-5 (§7.4.9)	4 kV 1.2/50 μ s open voltage circuit 8/20 μ s short current circuit
Immunity to conducted disturbances induced by RF according to IEC 61000-4-6 §7.4.8	10 V/m
Immunity to damped oscillatory waves according to IEC 61000-4-6 §7.4.10	2.5 kV – common mode 1 kV – differential mode
Radio interference suppression according to IEC 61000-4-6 §7.4.13	EN55022
Display	
Display type	seven-segmented liquid crystal display (LCD)
Data values digits	8
OBIS code digits	5
Digits size data/OBIS	8 mm / 6 mm
Display modes	Automatic / Manual / Test
Total energy display digits	6 integer 2 decimal in Automatic/Manual mode 5 integer 3 decimal in Test mode
Average power demand	5 integer 3 decimal
Phase voltage presence indicator	3 symbols L1, L2, L3
Meter status indicator	5 symbols
List of data displayed in automatic mode	programmable
List of data displayed in manual mode	programmable
Display period	programmable 5 to 20 second (default 8 sec.)
Tariff control	
Internally	using build-in real time clock
External - optional	using external device
Number of tariff	2 up to 4

Thermo-mechanical properties		
IP protection		IP54
Relative humidity (indoor mounting)	Annual average:	≤ 90% up to 40°C
	Boundary conditions:	≤ 95% up to 40°C
	Storage and transport:	≤ 95% up to 40°C
Capacity of measured/registered value profile memory		5 profiles, 10 channels
Billing profile (max 33 channels)		24 records
Load profile with recording period 1		5760 records
Load profile with recording period 2		5760 records
Load profile with recording period 3		1000 records
Load profile during test		1000 records
Logs		
Standard event log		1000 records
Power quality log		1000 records
Integrity violation log		1000 records
Disconnect log		1000 records
Communication log		1000 records
Power failure log		1000 records



1.1.3. Standards and references

IEC 62052-11	Electricity meter equipment (AC): General requirements, tests and test conditions - Part 11: Metering equipment
IEC 62053-21	Electricity metering equipment (a.c.) –Particular requirements Part 21: Static meters for active energy (classes 1 and 2)
IEC 62053-22	Electricity metering equipment (a.c.) –Particular requirements Part 22: Static meters for active energy (classes 0,2 S and 0,5 S)
IEC 62053-23	Electricity metering equipment (a.c.) –Particular requirements Part 23: Static meters for reactive energy (classes 2 and 3)
EN 50470-1	Electricity metering equipment (a.c.) —Part 1: General requirements, tests and test conditions - Metering equipment (class indexes A, B and C)
EN 50470-3	Electricity metering equipment (a.c.) —Part 3: Particular requirements — Static meters for active energy(class indexes A, B and C)
IEC 62056-21	Electricity metering - Data exchange for meter reading, tariff and load control Part 21:Direct local data exchange
IEC 62056-42	Electricity metering - Data exchange for meter reading, tariff and load control Part 42:Physical layer services and procedures for connection-oriented asynchronous data exchange
IEC 62056-46	Electricity metering - Data exchange for meter reading, tariff and load control Part 46: Data link layer using HDLC-Protocol
IEC 62056-47	Electricity metering - Data exchange for meter reading, tariff and load control Part 47: COSEM transport layer for IP networks
IEC 62056-53	Electricity metering - Data exchange for meter reading, tariff and load control Part 53: COSEM application layer
IEC 62056-61	Electricity metering - Data exchange for meter reading, tariff and load control Part 61: OBIS object identification system
IEC 62056-62	Electricity metering - Data exchange for meter reading, tariff and load control Part 62: Interface classes
DIN 43856-1989	Electricity meters, tariff time switchers and ripple control receivers; connection diagrams, terminal marking, circuit diagrams
DIN 43857	Watthour meters in moulded insulation case without instrument transformers up to 60 A rated maximum current
IEC 60529	Degrees of protection provided by enclosures (IP Code)
IEC13757-2	Communication system for meters and remote reading of meters part 2: physical and link layer
IEC13757-3	Communication system

2. Design of the meter

A compact meter case consist of:

- meter base with a terminal block
- meter cover
- terminal cover
- fixing elements for mounting the meter
- additional module case (for PLC, GPRS, RF, RS485 modules etc.)

2.1. Meter housing (construction)

The meter case is made of high quality self-extinguishing UV stabilized polycarbonate reinforced with 10% glass fibre, except for the transparent meter case cover. Terminal block is constructed as a removable with current clamps with one screw according to IEC 62052 – 11. The meter base has place to hold the electronic boards, protected by the manufacturer seals. There is also a place for the external communication module. The meter has IP54 protection level against dust and water penetration, in compliance with IEC 60529 standard.

2.1.1. Front and bottom view

Figure 2.1 shows a meter with terminal cover.



Figure 2.1 EWGE31xAxRx meter type – front view

2.1.2. Overall meter housing dimensions

Meter dimensions and hanging points are according to DIN 43 857, as shown in Figure 2.2.

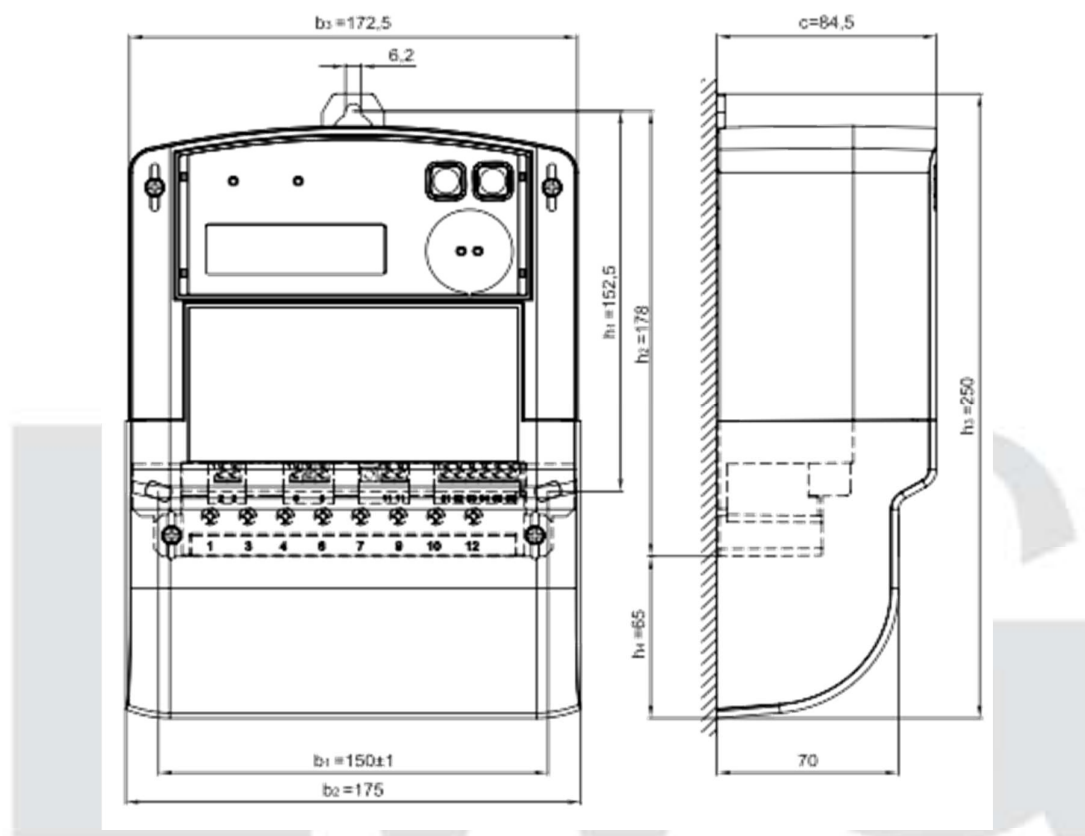


Figure 2.2. Dimensions of the meter

Table 2.1 External dimensions of the meter (in mm)

label	b1	b2	b3	h1	h2	h3	h4	c
dimension [mm]	150±1	175	172.5	152.5	178	250	65	84.5

2.1.3. Terminal block

The terminal block complies with the DIN 43857 standard. It is made of self-extinguishing high quality polycarbonate. Terminal block current terminals are made of brass. The surface of terminals can be additionally protected with nickel for the areas with extreme climatic conditions (e.g. tropical area).

Screws are made of zinc plated steel with pozidrive No.2 head type. The conductors can be fixed with one screw per terminal.

Auxiliary terminal block is made in two variants:

- variant 1: green terminals with screw for conductor tightening
- variant 2: grey terminals with a spring for conductor tightening

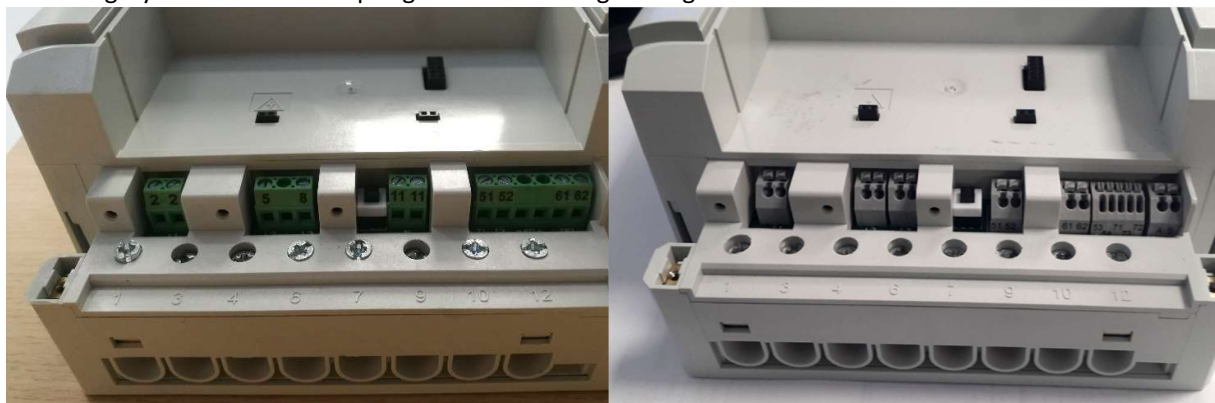


Figure 2.3. Meter terminal blocks

Auxiliary terminals are intended for the connection shown in Tables 2.2 and 2.3 for both variants respectively:

Table 2.2 Auxiliary terminals – *variant 1*

CONNECTOR	LABEL
TARIFF INPUT (optional)	
tariff input 1	51
tariff input 2	52
ELECTRICAL TEST OUTPUT (optional)	
SO-a/ SO-r plus	53
SO-a/ SO-r minus	54
RELAY	
input	61
output	62

Table 2.3 Auxiliary terminals – *variant 2*

CONNECTOR	LABEL
TARIFF INPUT (optional)	
tariff input 1	51
tariff input 2	52
ELECTRICAL TEST OUTPUT (optional)	
SO-a/ SO-r plus	53
SO-a/ SO-r minus	54
RELAY	
input	61
output	62
EXTERNAL SWITCH (optional)	
OFF	71
ON	73
COM	72
RS485	
	A
	B

For meters with internal switch, auxiliary connections 71, 72 and 73 are not made because there is no need to install an external switch. Tariff input (51,52) and electrical test outputs (53, 54) are optional, while in Variant 1 the RS485 is added as a separate external module.

Dimensions of terminal blocks are shown on figures 2.4 and 2.5 and they are the same for both variants of auxiliary block.

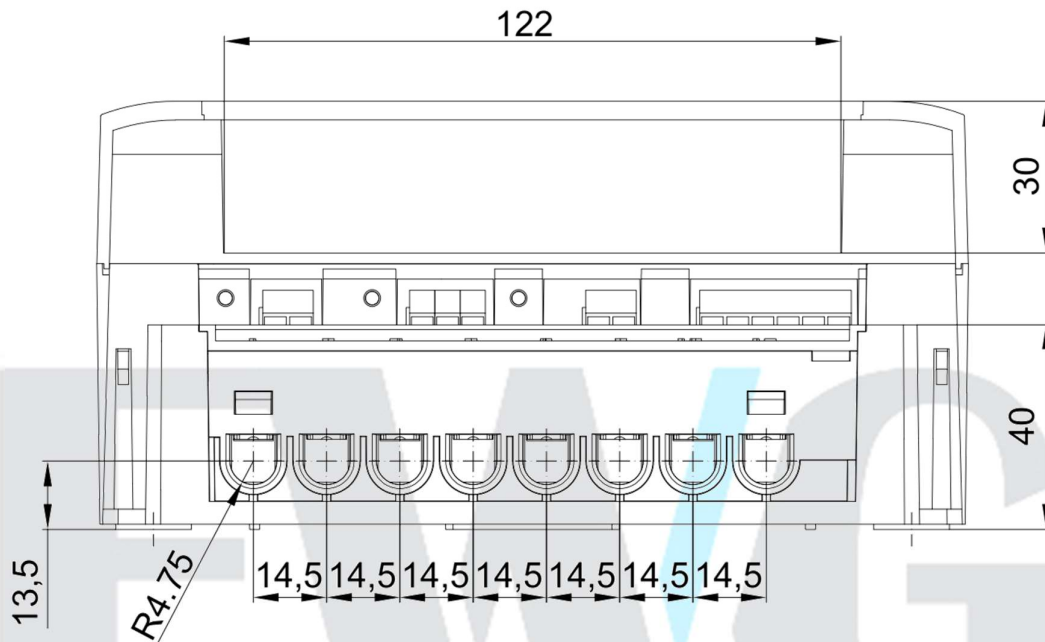


Figure 2.4 EWGE31xxx meter terminal dimension (without modem)

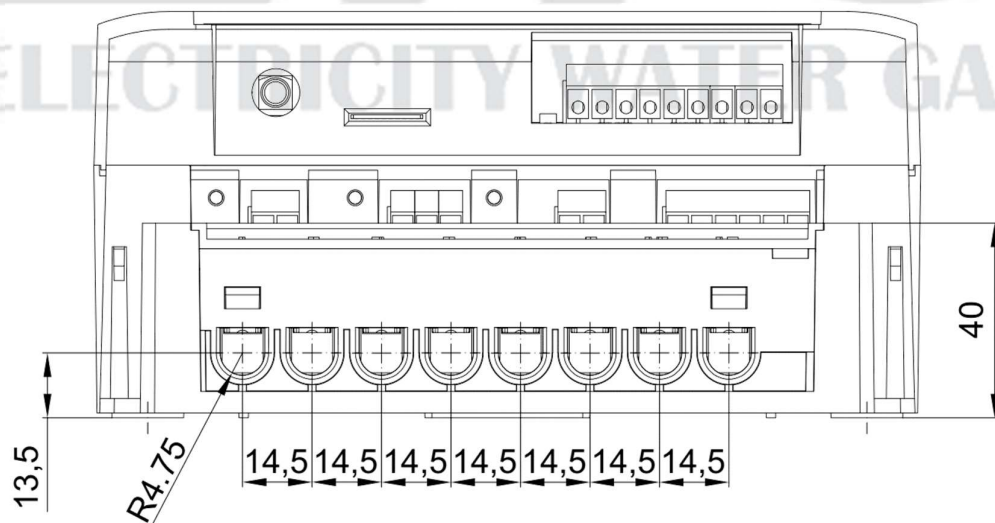


Figure 2.5 EWGE31xxx meter terminal dimension (with GPRS modem)

Labels of terminal block are shown on figures 2.6 and 2.7

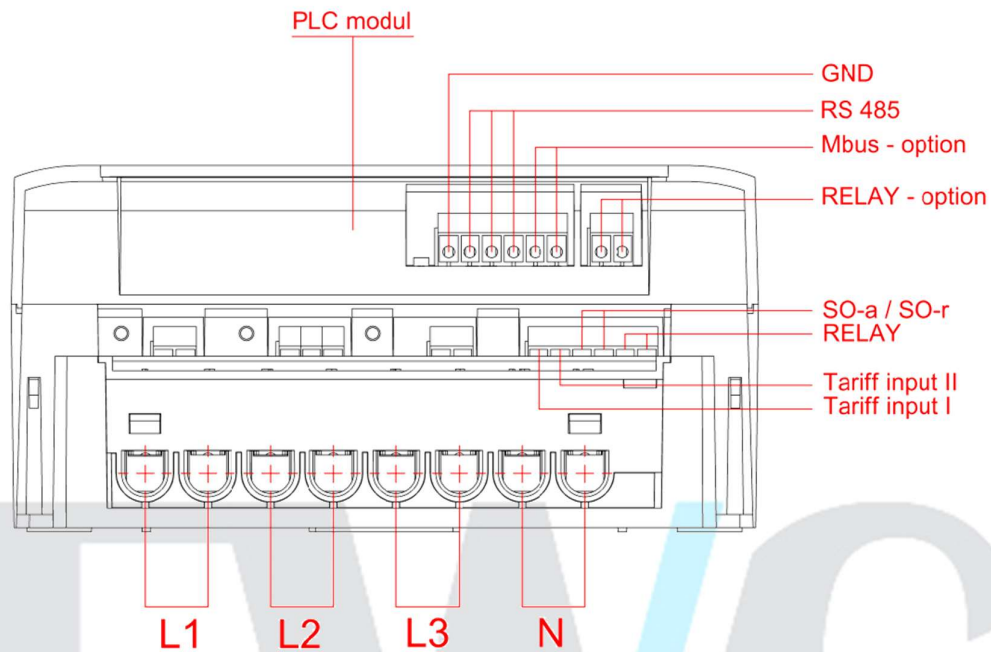


Figure 2.6 EWGE31xxx meter with PLC modem terminal labels – variant 1

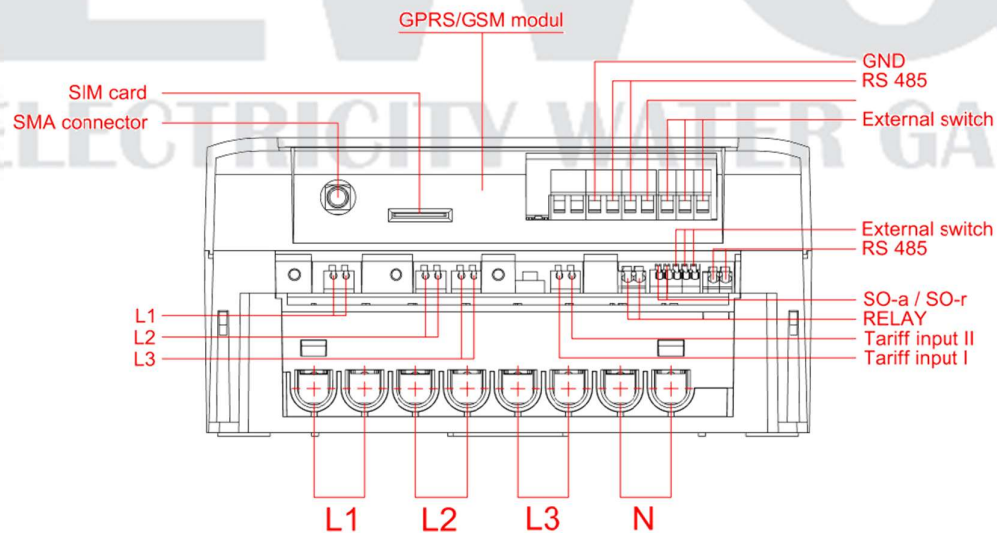


Figure 2.7 EWGE31xxx meter with GPRS modem terminal labels – variant 2

2.2. Meter labels

2.2.1. Name plate

Basic meter's data are shown on the name-plate, located on the front of the meter and printed using an indelible method or lasered on meter cover. Name plate of EWGE31xAxRx family meters has showed on figure 2.8 with description according to Table 2.3.

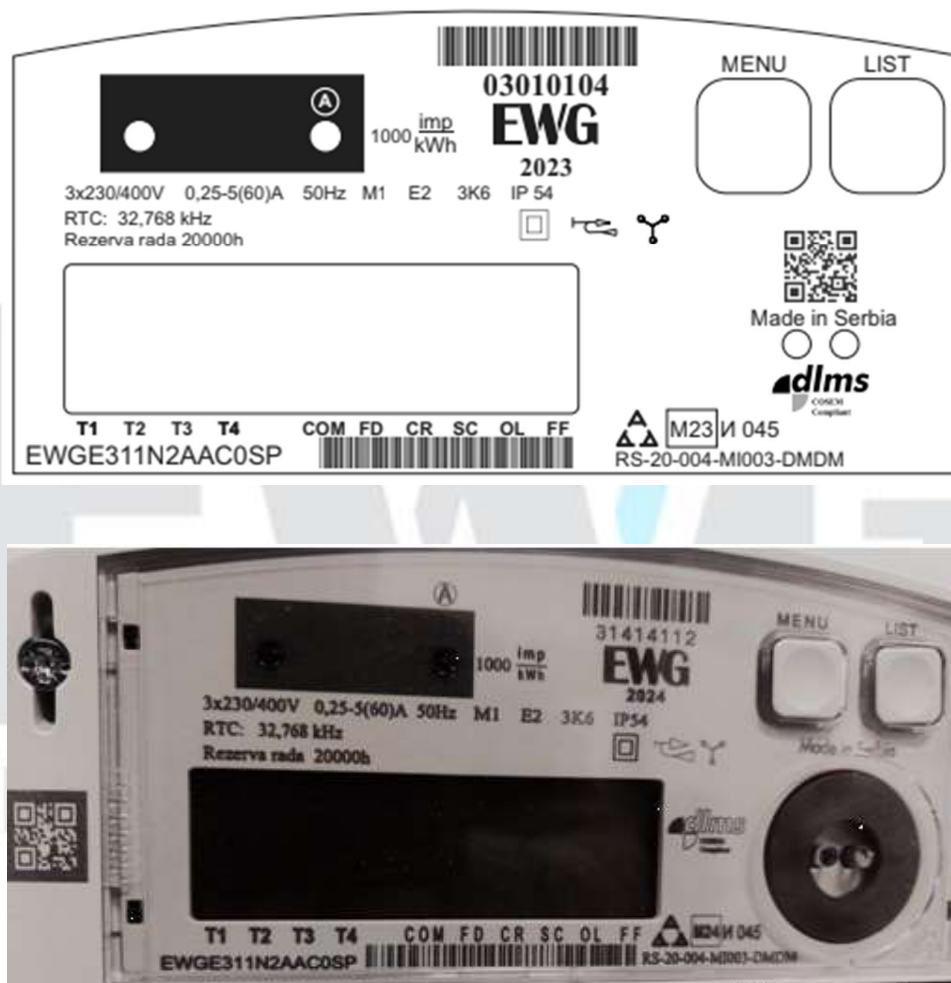


Figure 2.8 Name plate EWGE31xxx (on sheet upper, lasered lower)

Table 2.3 List of data printed on name-label

Item	Description
1	Name of the manufacturer
2	Rated accuracy class
3	Year of manufacture
4	Barcode with the meter serial number
5	Serial number
6	Constants of optical output impulses
7	Serbian mark of conformity and additional metrological mark
8	Certificate number
9	Type approval label (official label of the competent authority)
10	Marks on display T1 – T4 active tariff
11	Meter type label
12	Barcode with the meter type
13	Rated voltage
14	Minimum, nominal and maximum current
15	Rated frequency
16	Protection class label IP54
17	Class II insulation level label
19	Mechanical protection class M1
19	Electromagnetic class E2
20	Working temperature 3K6
21	DLMS Communication protocol
22	QR code - Unique identification number (UIN) of the meter

2.2.2. OBIS code plate

OBIS code plate is located on terminal block cover and is shown in the Figure 2.9.

8.8...	Display test						
F.F.	Error						
0.9.1	Time						
0.9.2	Date						
C.1.0	Serial number						
		 +A + -A 	+A	-A	+R	-R	
		15.8.0	1.8.0	2.8.0	3.8.0	4.8.0	Energy total
		15.8.x	1.8.x	2.8.x	3.8.x	4.8.x	Energy in tariff x
			1.6.x				P_{max} in tariff x
14.7.0	Frequency		1.5.0				Last demand
13.7.0	cos(φ)		1.7.0	2.7.0	3.7.0	4.7.0	Power
		Tariff: x = 1, 2, 3, 4					

Figure 2.9 OBIS code plate for EWGE31xAxRx family meters

2.2.3. Connection diagram

The meter connection diagram for the direct connected meters is located on inner side of terminal block cover (back to OBIS code plate). Figure 2.10 shows connection diagram for direct connected meters with auxiliary terminal block variant 1 and Figures 2.11 and 2.12 shows connection diagram for direct connected meters with auxiliary terminal block variant 2 with and without of external switch connectors respectively.

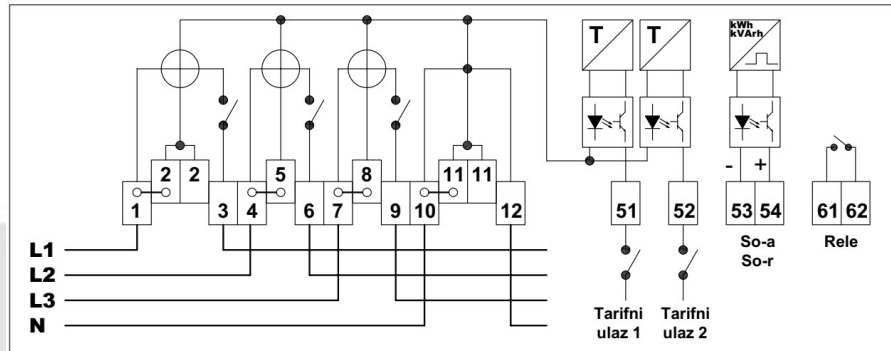


Figure 2.10 Direct connected meter connection scheme - variant 1

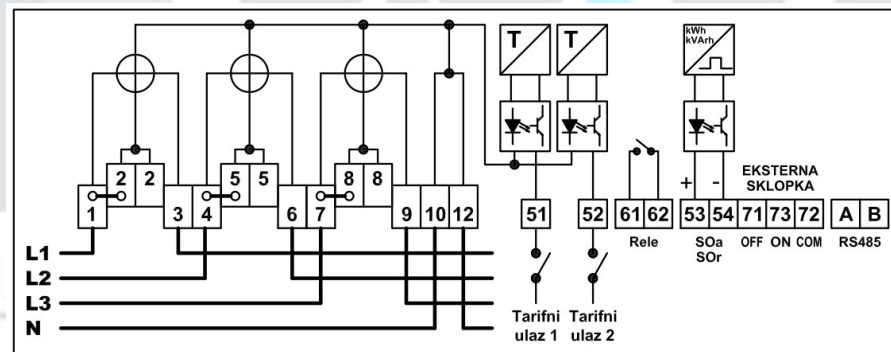


Figure 2.11 Direct connected meter connection scheme variant 2

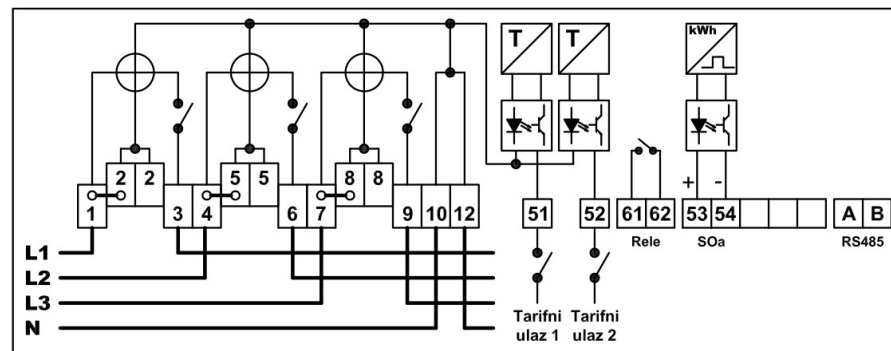


Figure 2.12 Direct connected meter connection scheme variant 2 with internal switch

The communication module case is made of 10% glass fiber reinforced polycarbonate. The module case dimensions that the meter base can hold are 30x60x122mm. It is designed to hold different types of communication modules as PLC, GPRS, NBIoT, RF, RS485. The module case is covered by the transparent terminal block cover. The module is protected by the utility seal(s).

The meter cover can be sealed with two sealing screws. Usually after the process of the metrological testing in authorized laboratory manufacturer put own seals on meter case cover.

3. Electronic boards – PCB's

EWG meters consist of two main electronic boards inside the meter case and additional communication board in external module case:

- upper board – display/measuring board - hardware version marked EWGDST95 and
- lower board – power board with external tariff inputs, test outputs, relay outputs and sensors - hardware version marked EWG3D43.

3.1. Upper electronic board

Upper board hosts the measurement chip 71M6533 and the communication chip STM32F071 or newer STM32G0B0 as well as display. Figure 3.1 shown block diagram of two main microcontrollers.

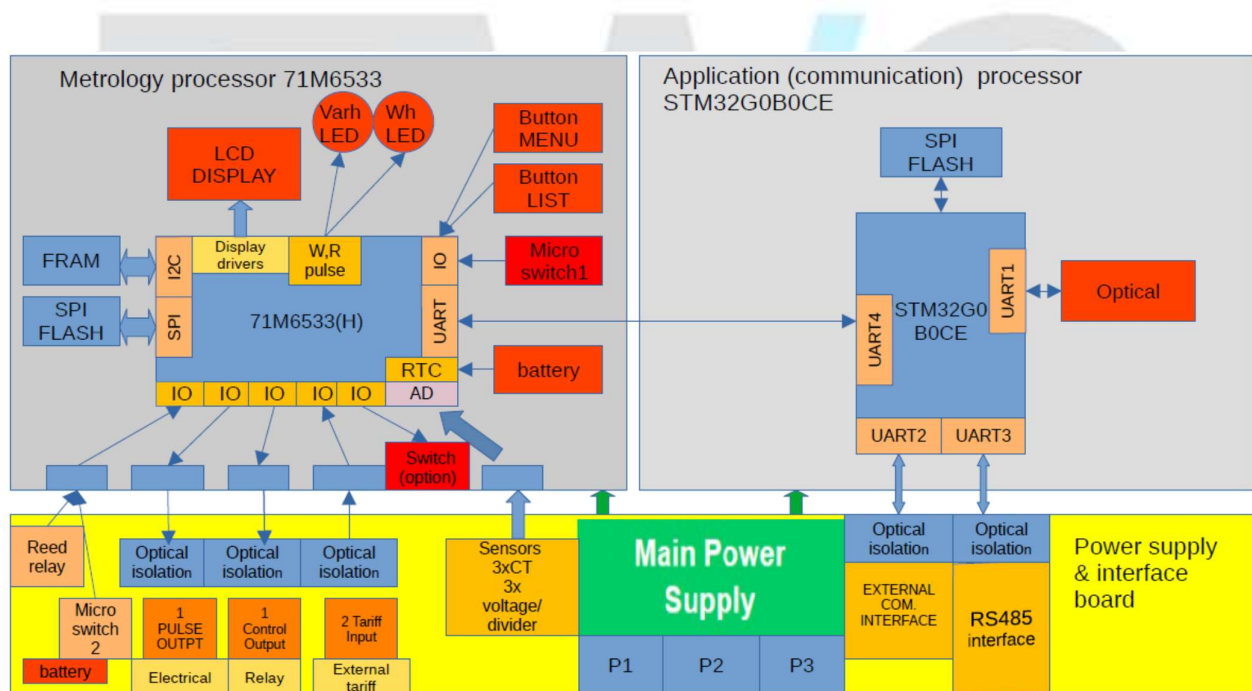


Figure 3.1 Microcontrollers block diagram

The measuring system based on the energy meter "system on chip" (SoC) Teridian 71M6533 which integrates all primary functional blocks required to implement a solid-state electricity meter. Included on the chip:

- analogue front end (AFE) with 22 bit $\Delta\Sigma$ AD converter
- independent digital 32 bit computation engine (CE)
- 8051-compatible microprocessor (MPU)
- LCD drivers
- RAM and Flash memory
- real time clock (RTC)
- variety of I/O pins

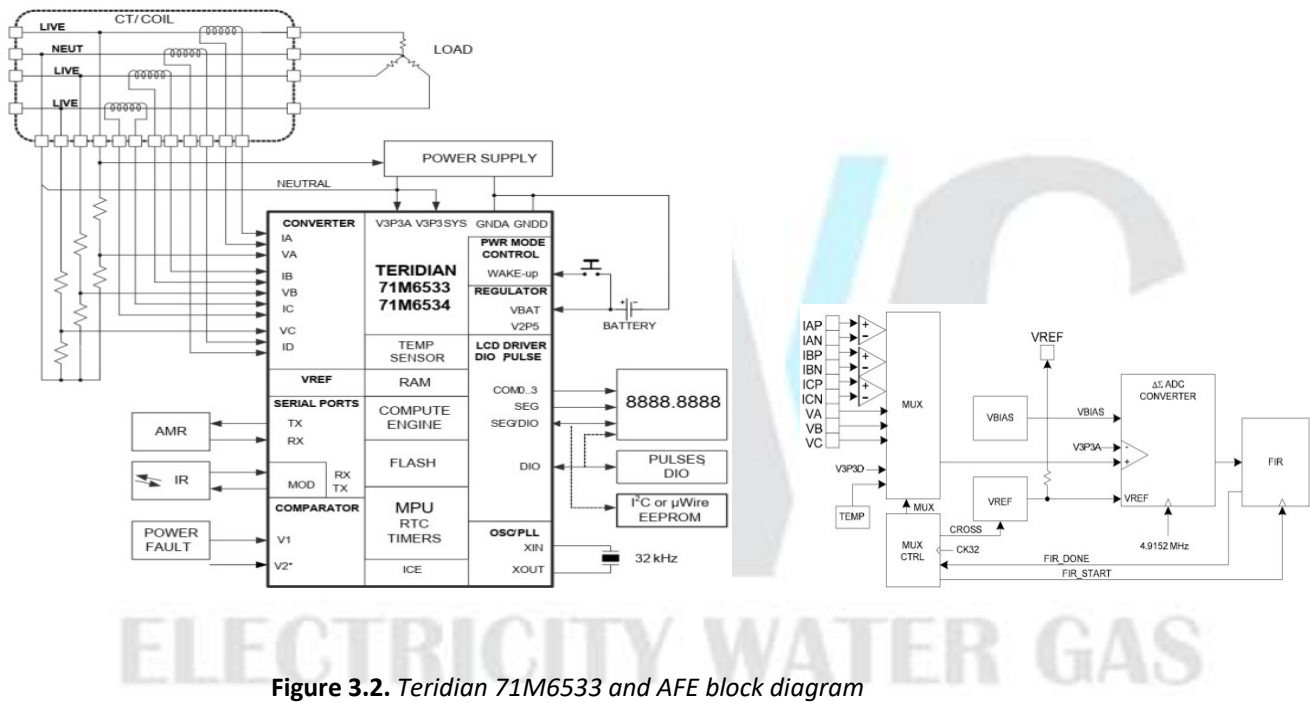


Figure 3.2. Teridian 71M6533 and AFE block diagram

3.1.1. Signal input pins

E31xxx family meters are based on the three measurement systems with three voltage and three current channels. The current channels use current transformers as a sensors and the voltage channels use voltage dividers. All analogue signal input pins are voltage sensitive. The voltage pins $V_A - V_B - V_C$ is single-ended. Current pins $I_{AP}/I_{AN} - I_{BP}/I_{BN} - I_{CP}/I_{CN}$ in EWG application is programmed to be differential.

3.1.2. Analogue front end (AFE)

The AFE functions as a data acquisition system, controlled by the microprocessor (MPU). The main blocks in the AFE consist of an input multiplexer, a delta-sigma A/D converter, a FIR decimation filter and a voltage reference. The analogue input signals are multiplexed before being sampled by the A/D converter. The A/D converter output is decimated by the FIR filter and the results are stored in XRAM where they can be accessed by the computation engine (CE) and the microprocessor (MPU).

3.1.3. Digital computation engine (CE)

The computation engine (CE), a dedicated 32-bit digital signal processor, performs the back-end computations. The CE calculations include:

- Multiplication of each current sample with its associated voltage sample to obtain the energy per sample (when multiplied with the constant sample time)
- Gain and offset compensation
- Delay compensation on all channels (caused by the multiplexing scheme)
- 90° phase shift for VAR calculations
- Frequency measurement
- Accumulation for voltage and current RMS and power computation
- Active, reactive, apparent, fundamental, and harmonic power calculation
- Fundamental and harmonic current and voltage calculations
- Monitoring of the input signal frequency (for frequency and phase information)
- Monitoring of the input signal amplitude (for sag detection)
- Temperature acquisition

3.1.4. 80515 microprocessor core (MPU)

The 71M6533 include an 80515 MPU (8-bit, 8051-compatible) that processes most instructions in one clock cycle. Using a 10 MHz clock results in a processing throughput of 10 MIPS.

The 80515 MPU core incorporates the Harvard architecture with separate code and data spaces. Memory organization in the 80515 is similar to that of the industry standard 8051. There are four memory areas: Program memory (Flash, shared by MPU and CE), external RAM (Data RAM, shared by the CE and MPU), Configuration RAM and internal data memory (Internal RAM).

3.1.5. ARM microprocessor (core M0)

The STM32G0B0 microcontroller incorporate the high-performance ARM® Cortex®- M0 32-bit RISC core operating at up to 48 MHz frequency, high-speed embedded memories, and an extensive range of enhanced peripherals and I/O.

On the upper board (display-metering module)


- optical port for local communication,
- optical test output – two LED diodes,
- two navigation buttons (MENU and LIST),
- micro-switch for meter cover opening detection.

3.1.6. Optical test output

Optical test output form two LEDs on the front end of the meter. One LED is used for active energy and second one is reserve for reactive energy when measurement of reactive energy consumption is on. Optical test output is intended for the meter calibration and accuracy testing.

The distance between two diodes is 25 mm and it is sufficiently long to avoid any interference.

Optical test output is in conformance with IEC 62052-11 standard §5.11. Pulses are not modulated and have waveforms as described in figure 3.5 below:

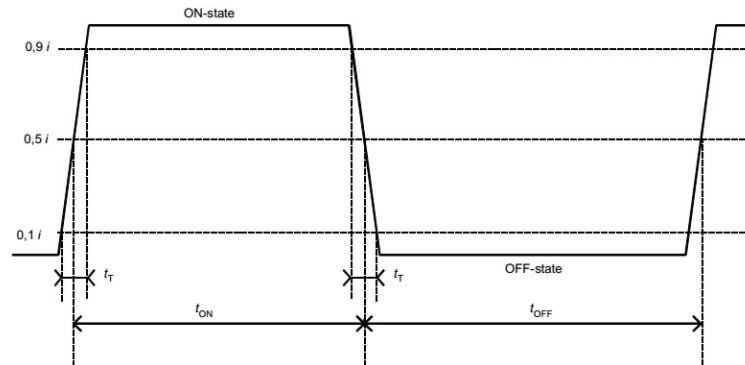

Picture 3.5 Waveform of the optical test output

where $t_{ON} \geq 0.2$ ms, $t_{OFF} \geq 0.2$ ms and $t_T < 20$ μ s.

Constant of optical test output is 1000 pulse/kWh for active energy and 1000 pulse/kVARh for reactive energy. Maximum number of pulses is 16 per second.

3.1.7. Meter buttons

Two buttons, labelled MENU and LIST, located on the front side of the meter used for navigation through data displayed on the LCD. Browsing algorithm has shown in chapter 4.2.

In some cases buttons can be used for customer reconnection (closing disconnector) on the electrical grid. Synchronized push of both keys MENU and LIST for at list 2 seconds result as escape (ESC) function.

3.2. Lower electronic board

The lower electronics board provides connection on the grid through the current and voltage sensors (current measurement transformers, voltage dividers). Main power supply for the meter itself as well as for the external modules located on lower electronic board.

More on the lower electronics board (power module):

- electrical pulse test output,
- external tariff input,
- auxiliary relay output,
- micro-switch for the terminal cover opening detection,
- sensor for magnetic field detection and
- electrical communication port.

3.2.1. Power supply

The power source is designed in such a way as to enable uninterrupted meter operation even in the case of disconnection in the neutral conductor, or in the event of detection of a phase/neutral conductor crossing.

3.2.2. Electrical test output (optional)

The meter has the electrical test output connected to the auxiliary terminal pins labelled as 53 and 54.

Electrical test output is optically isolated and passive.

Pulse output specifications are according to IEC 62053-31 and IEC 62052-11 standards:

- open collector,
- maximum voltage 27 V,
- maximum current in ON-state 27 mA,
- minimum current in ON-state 10 mA,
- maximum current in OFF-state 2 mA,

Pulse duration is set on 40 ms. This is factory setting, and can be changed during process of initialization of the meter. So constant is 500 pulses/kWh for active energy and 500 pulses/kVAh for reactive energy.

3.2.3. Auxiliary relay

The meter is equipped with one pole auxiliary relay with maximum switching current of 5 A at 230 V, connected to auxiliary meter terminal, labelled as 61 and 62. The section of the acceptable conductors is at most 2.5 mm².

The control output is typically activated from the centre or in accordance with the current tariff programme. However, activation of control output is programmable.

3.2.4. Internal supply control switch (option)

EWG E31xNxRx meters for direct connection, can optionally have an integrated supply control switch (SCS) for disconnecting and reconnecting the consumer's supply.

The supply control switch (SCS) is a latching relay.

A latching relay keeps its contact position indefinitely without power applied to the coil. The advantage is that the coil consumes power only for an instant moment while the relay is being switched, and the relay contacts retain this setting across a power outage.

It is located between the supply input and load output terminals.

The relay is able to make, carry and break all values of currents between the minimum switched current rating to the rated breaking current for all values of the rated operating voltage range and the specified operating temperature range of the meter.

The meter is fitted with a three 100 A latching relays.

Technical characteristics for latching relay :

- conforms to IEC 62052-31 UC3
- Maximum switching current: 100 A
- Coil specification: double coil
- Rated coil voltage: 12 VDC
- Coil Consumption : 3W
- Pulse duration: 60 ms
- Endurance / Number of operating cycles : mechanical life 100.000 ; electrical life 10.000 cycles
- Dielectric Strength Contact – coil : AC 4, 000V; 50/60Hz 1min
- Creepage distance : 8 mm

The neutral output is not interrupted.

SCS is used for remote disconnection and reconnection of electric network to individual customers. The basic 100 A latching relays allows remote, local (by a function of the meter, e.g. limiter) and manual (by push buttons) types of control. The remote control can be carried out by address command for a meter and by group command for a group of meters.

Disconnect and reconnect can be requested:

- Remotely, via a communication channel: remote disconnect, remote reconnect,
- Manually, using MENU and LIST keys : manual reconnect, disconnect
- Locally, by limiter: where supply can be disconnected if the consumer exceeds the load limit power threshold (Active power threshold in kW). Reconnection can be maintained by ensuring that consumer usage is below the disablement threshold.

3.3. Meter communication ports

The EWG meter has three independent communication channels:

- Infrared optical port
- Electrical interface No. 1 – external module communication port
- Electrical interface No. 2 – external switching device port
- Electrical interface No. 3 – HAN (Home Area Network) port
- Electrical interface No. 4 – RS485

3.3.1. Optical port

The meter has build-in optical communication port used for local meter data readouts and settings via hand-held units (HHU).

The optical port operates in accordance with the standard for direct local data exchange IEC 62056-21. On the physical layer optical interface operates according to IEC 62056-21 mod C and on the application layer complies with IEC 62056-46 DLMS/COSEM communication protocol. The communication is achieved using HDLC common interface.

3.3.2. Electrical communication port

Electrical communication channel is implemented on TTL level serial interface. The meters family E311xxx and uses PLC and GPRS modules for external communication. PLC and GPRS modules optionally can integrate RS485 interface.

Optionally GPRS module can integrate HAN interface.

Electrical communication channel as well as RS485 and HAN interface are optically isolated.

3.3.3. Electrical interface number 3 – HAN

Functionality related to HAN can be implemented using Electrical interface number 4 RS485 if it is not used for the local meter network or via an external module on which an optically isolated RS485 interface is implemented.

If electrical interface number 3 is implemented on an external module, it is implemented as an optically isolated RS485 communication interface on a GPRS module, NBIOT module, LTE module or RS485 module.

Power supply for RS485 interface is through isolated 1 Watt DC to DC power converter with 4.2KVac and 6KVdc isolation voltage specifications (duration 1 min).

RS485 interface is optically isolated with two optocouplers H11L1 with Insulation voltage 5kV.

This interface is used to connect the meter to the HAN (Home Area Network).

This interface is implemented as galvanically insulated RS485 port with implemented protocol according to the DLMS/COSEM push mechanism.

3.3.4. Electrical interface number 4 - RS485

It is used for connecting several meters to the bus in cases of grouped installation of meters .

For this purpose, the RS485 interface on the meter, or the RS485 interface on GPRS, NBIOT or LTE modules can be used.

Power supply for RS485 interface is through isolated 1 watt DC to DC power converter with 4.2KVac and 6KVdc isolation voltage specifications (duration 1 min).

RS485 interface is optically isolated with two optocouplers H11L1 with Insulation voltage 5kV.

This interface is used to connect the meter to the HAN (Home Area Network) modem/module through existing electrical RS485 interfaces, in a way that does not interfere with communication with other modules. This interface is implemented as galvanically insulated RS485 port with implemented protocol according to the DLMS/COSEM push mechanism.

3.4. Pushing Process

The pushing process is done by using three main groups of COSEM objects as follows:

- Triggering Objects;
- Script Table;
- Pushing Message;

A trigger calls a script in Push Script Table (9, 0-0:10.0.108.255) and the called script invokes the "Push" method of relevant "Push Setup" objects. At the end, the "Push" method of "Push Setup" object sends the specified message/data to Central System.

3.4.1. Triggering Objects

The devices can be woken up by a trigger to connect to network and exchange data with Central System. This is called Triggering Process. The trigger can be internal or external.

3.4.1.1 Internal Triggering

Internal trigger can be the result of an internal process inside the device (meter) such as Alarm or reaching a time specified by a schedule or from push script table.

The meter can be triggered on a regular basis to setup a connection. On the regular time, indicated by the Execution time (attribute 4) the associated script in attribute 2 is executed. This script is executed and the Push Setup object will trigger the connection management. In case this functionality is not used, the Execution time will be empty.

3.4.1.2 Internal triggering by Push Scheduler

Following Internal Triggering Objects are generated by Push Schedulers :

- Push action scheduler – Interval 1, (22 , 0-1:15.0.4.255)
- Push action scheduler – Interval 2, (22 , 0-2:15.0.4.255)
- Push action scheduler – Interval 3, (22 , 0-3:15.0.4.255)
- Push action scheduler – Consumer Information, (22 , 0-4:15.0.4.255)

3.4.1.3 Internal triggering by Alarms

The meter can be triggered by an alarm to setup a connection. An event can cause an alarm (depending on the alarm filter). If a monitor threshold is exceeded (Alarm) the associated script in attribute 4 is executed. This script is executed and the Push Setup object will trigger the connection management. In case this functionality is not used, the Actions array will be empty.

3.4.1.4 Internal triggering by an event

The meter can be triggered by events : installation, power-down or established PDP context.

Event-triggered meter reporting objects:

- Push setup - On Installation, 0-7:25.9.0.255, triggered by “commissioning event”
- Push setup - On power down, 0-5:25.9.0.255, triggered by long power failure.

3.4.1.5 Pushing Message objects

The final stage in triggering process is pushing the message (data or information). This stage is handled by "Push Setup" objects from Class 40.

The following "Push Setup" objects have been used :

- PushSetup-Interval-01 (40, 0-1:25.9.0.255);
- PushSetup-Interval-02 (40, 0-2:25.9.0.255);
- PushSetup-Interval-03 (40, 0-3:25.9.0.255);
- PushSetup-On-Alarm (40, 0-4:25.9.0.255);
- PushSetup-On-Connectivity(On-Connectivity) (40, 0-0:25.9.0.255);
- PushSetup-MeterOn-Installation (40, 0-7:25.9.0.255);
- PushSetup- ConsumerInformation(40,0-6:25.9.0.255)
- PushSetup- On Power down (40,0-5:25.9.0.255)

3.5. COSEM objects for CIP functionality using PUSH operation (option)

Push setup – Consumer information (0-6:25.9.0) is used to transmit information to local port (i.e. IHD) serving as Consumer Information Interface (CII) to support the optional Consumer Information Push (CIP) functionality. Field *Send destination and method* need to be properly set. Depending on the market request, this local port may be connected to a suitable home gateway.

Communication interface port can be used as 1-way read-only communication interface which can be intended to connect the In-House Display (IHD) or interface for In-House Display (IHD) to the meter.

4. LCD - data display procedure

4.1. Display

The seven-segmented liquid crystal display (LCD) fully complies with the VDEW requirements.

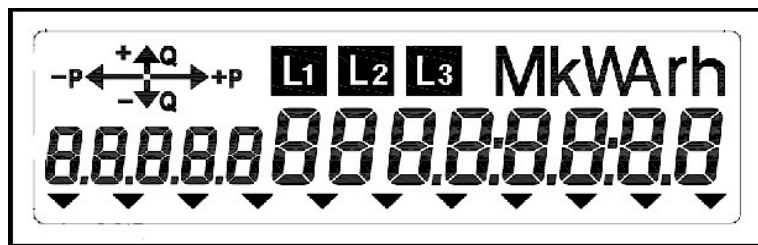


Figure 4.1 *The meter display*

4.1.1. Alphanumeric fields (data value and OBIS code field)

Data value field is used for presentation of the data values and consists of eight 7-segmented digits. High of digits in the data value field is 8 mm.

OBIS code field is used for presentation of the OBIS identification codes of the displayed data and consists of five digits. High of the digits in OBIS code field is 6 mm.

4.1.2. Physical units field

Physical unit field shows physical units of data displayed in data value field. List of units can be shown in physical unit field is listed below:

kW, kWh, kVAr, kVArh, A, V.

4.1.3. Power flow direction cursors

There are four power flow direction cursors on the display:

- Positive active power flow +P,
- Positive reactive power flow +Q,
- Negative active power flow -P,
- Negative reactive power flow -Q.

4.1.4. Phase voltage presence indicator

Segments L1, L2 and L3 show the presence of appropriate phase voltages.

In case of irregular connections:

- Reverse connection of input-output conductors causes appropriate phase indicator blinking at 1 Hz frequency.
- Swapping of phase and neutral conductors causes all three phase indicators blinking at 1 Hz frequency.
- Absence of phase voltage causes appropriate phase indicator fade-out. Voltage drop below 50% of nominal voltage is valued as the absence of corresponding phase voltage. This is default parameter and can be changed.

4.1.5. Tariff and error cursors

On the name-plate (below the LCD) the meter has printed labels that belong to the cursor on the LCD. The cursor shows the active tariff and the state of certain functions or errors of the meter.

COM – communication in progress

FD – fraud detection

CR – code red activated

SC – switch disconnected

OL – power limit exceeded (overload)

FF – error register (the cursor lit up continuously if any fatal error – meter failure)

4.2. Data Display Procedure

Meter's data can be displayed in one of the three operating modes:

- automatic
- manual
- test

Default operating mode is automatic.

Navigation through data displayed on LCD is carried out by two buttons MENU and LIST. Navigation diagram is shown in Figure 3.2. Transition time between displays:

- t1 = 8 seconds,
- t2 = 20 seconds.

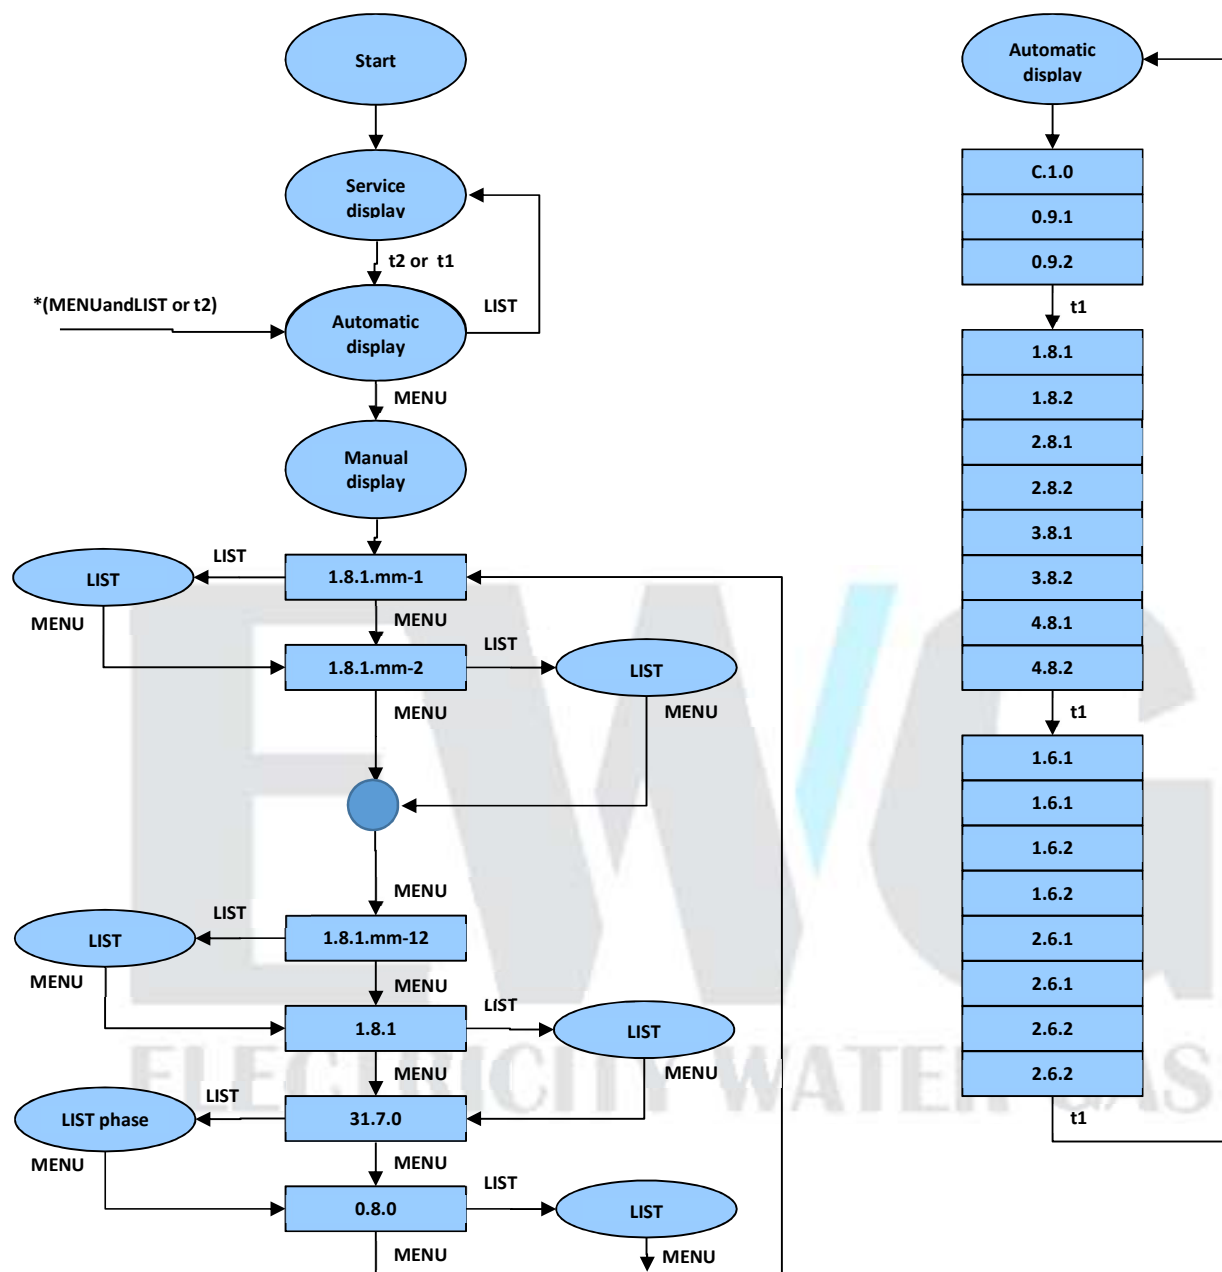


Figure 4.2 Display navigation diagram

By pressing MENU button meter switches from automatic to the manual mode. The appropriate menu can be selected by pressing of MENU button repeatedly.

If meter works in automatic mode, by pressing LIST button display switches to test mode. If meter works in manual mode by pressing LIST button different data is shown from the chosen menu.

Transition from manual or test mode to default (automatic) mode can be done by simultaneous pressing MENU and LIST buttons for 2 seconds if terminal cover is set on the meter or automatically after 20 seconds if no one button is pressed.

The navigation buttons MENU and LIST are used for navigation through the data and may not affect the data it self.

4.2.1. Automatic mode

In automatic mode, the measured values are displayed in cycles with a programmable display period. Display period duration ranges from 5 to 20 seconds. Default value of the transition period is 8 sec.

The list of the data that can be displayed in automatic mode is given in Table 3.1. The order and the number of the data to be displayed is programmable. The initial display list is shown in Table 3.2.

Table 4.1

Ref. no. of the items in the list	OBIS CODE	Description	Class	Unit
1	F.F	Error code (meter failure only)	1	
2	C.1.0	Manufacturer's serial number	1	
3	0.9.1	Time – local	1	
4	0.9.2	Date – local	1	
5	1.8.0	Positive active energy A+ total	3	kWh
6	1.8.T	Positive (import) active energy (A+) in tariff T (T=1 to 4)	3	kWh
7	2.8.0	Negative active energy A- total	3	kWh
8	2.8.T	Negative active (export) energy (A-) in tariff T (T=1 to 4)	3	kWh
9	3.8.0	Positive reactive energy R+ total	3	kWh
10	3.8.T	Positive reactive (import)energy (R+) in tariff T (T=1 to 4)	3	kvarh
11	4.8.0	Negative reactive energy R- total	3	kWh
12	4.8.T	Negative reactive (export)energy (R-) in tariff T (T=1 to 4)	3	kvarh
13	1.6.0	Positive active maximum demand total	3	kWh
14	1.6.T	Positive active maximum demand (P_{max+}) with Time stamp in tariff T (T=1 to 4)	4	kW
15	2.6.0	Negative active maximum demand total	3	kWh
16	2.6.T	Negative active maximum demand (P_{max-}) with Time stamp in tariff T (T=1 to 4)	4	kW

Table 4.2

Ref. no. of the items in the list	OBIS CODE	Description	Class	Unit
1	F.F	Error code (meter failure only)	1	
2	C.1.0	Manufacturer's serial number	1	
3	0.9.1	Time – local	1	
4	0.9.2	Date – local	1	
5	1.8.1	Absolute active energy (A+) in tariff T1	3	kWh
6	1.8.2	Absolute active energy (A+) in tariff T2	3	kWh
7	2.8.1	Absolute active energy (A-) in tariff T1	3	kWh
8	2.8.2	Absolute active energy (A-) in tariff T2	3	kWh
9	3.8.1	Absolute reactive energy (R+) in tariff T1	3	kWh
10	3.8.2	Absolute reactive energy (R+) in tariff T2	3	kWh
11	4.8.1	Absolute reactive energy (R-) in tariff T1	3	kWh
12	4.8.2	Absolute reactive energy (R-) in tariff T2	3	kWh
13	1.6.1	Positive active maximum demand ($P_{\max+}$) in tariff T1	4	kW
14	1.6.1	Time stamp	4	
15	1.6.2	Positive active maximum demand ($P_{\max+}$) in tariff T2	4	kW
16	1.6.2	Time stamp	4	

EWG
ELECTRICITY WATER GAS

4.2.2. Manual mode

Manual mode gives a read-out of the data referring to billing, instantaneous power, voltage, current, frequency, power factor.

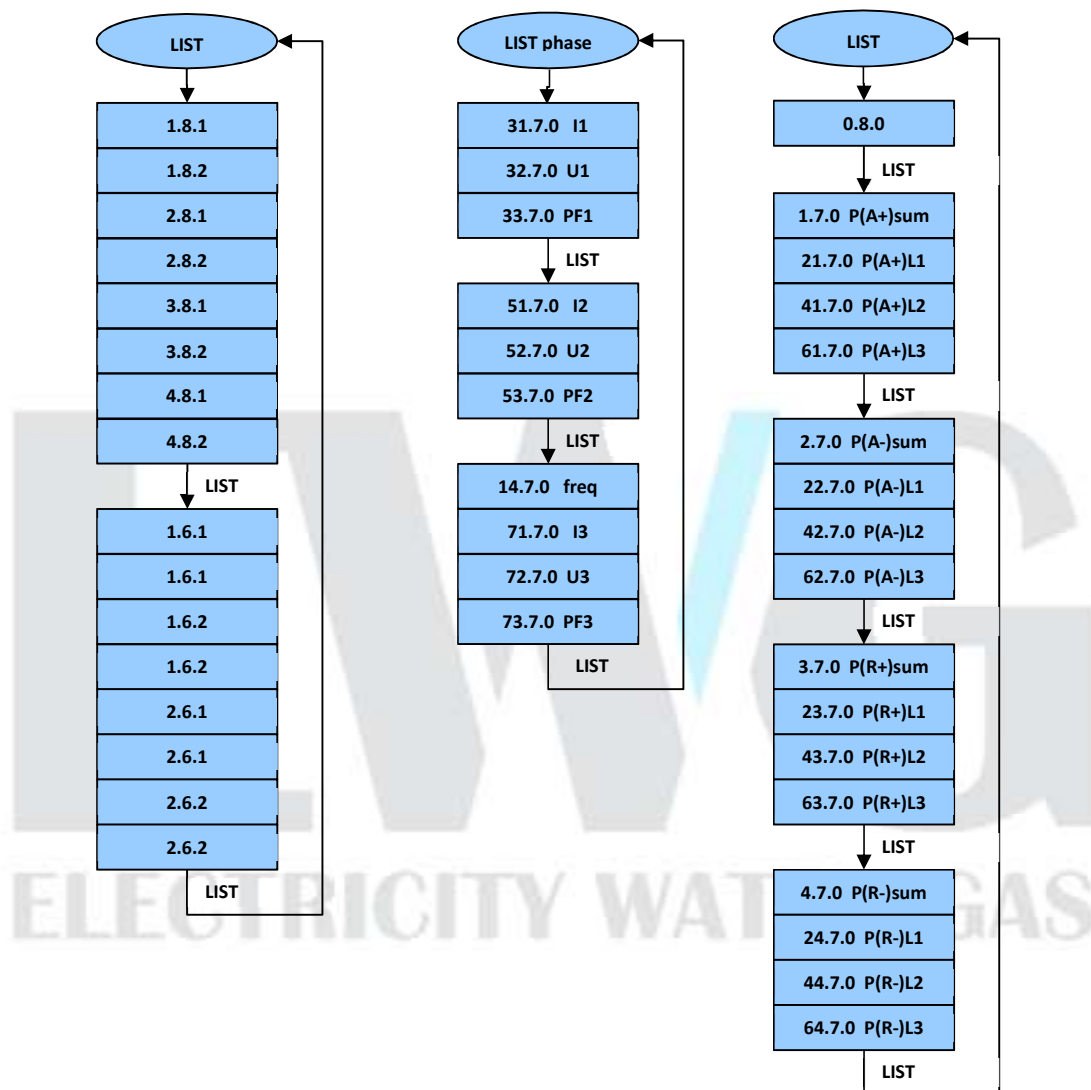


Figure 4.3 Display navigation diagram – manual mode

A list of possible items - OBIS codes intended for display in manual mode is given in Table 4.3. The order and number of the data presented in the list is programmable. The initial data list is shown in Table 4.4.

Table 4.3

Ref. No. of the items in the list	OBIS CODE	Description	Class	Unit
1	F.F	Error code (meter failure only)	1	
2	C.1.0	Manufacturer's serial number	1	
3	0.9.1	Time – local	1	
4	0.9.2	Date – local	1	
5	1.8.0	Positive active energy A+ total	3	kWh
6	1.8.Tvz	Positive active energy (A+) in tariff T* - last completed month	3	kWh
7	2.8.Tvz	Negative active energy (A-) in tariff T* - last completed month	3	kWh
8	3.8.T vz	Positive reactive energy (R+) in tariff T* - last completed month	3	kvarh
9	4.8.Tvz	Negative reactive energy (R-) in tariff T* - last completed month	3	kvarh
10	1.6.Tvz	Positive active power maximum demand ($P_{\max+}$) in tariff T* - last completed month	4	kW
11	1.6.Tvz	Time stamp	4	
12, 13	2.6.Tvz	Positive active power maximum demand ($P_{\max+}$) with Time stamp in tariff T* - last completed month	4	kW
14	14.7.0	Frequency	3	Hz
15	1.7.0	Total positive active instantaneous power (P+)	3	kW
16	90.7.0	Total current (all three phase sum)	3	A
17	31.7.0	Instantaneous current (I) in phase L1	3	A
18	32.7.0	Instantaneous voltage (U) in phase L1	3	V
19	51.7.0	Instantaneous current (I) in phase L2	3	A
20	52.7.0	Instantaneous voltage (U) in phase L2	3	V
21	71.7.0	Instantaneous current (I) in phase L3	3	A
22	72.7.0	Instantaneous voltage (U) in phase L3	3	V
23	21.7.0	Positive active instantaneous power (P+) in phase L1	3	kW
24	41.7.0	Positive active instantaneous power (P+) in phase L2	3	kW
25	61.7.0	Positive active instantaneous power (P+) in phase L3	3	kW

* Tariff T= 1 to 4

Table 4.4

Ref. No. of the items in the list	OBIS CODE	Description	Class	Unit
1	F.F	Error code (meter failure only)	1	
2	C.1.0	Manufacturer's serial number	1	
3	0.9.1	Time – local	1	
4	0.9.2	Date – local	1	
5**	1.8.1 vz	Positive active energy (A+) in tariff T1 - last completed month	3	kWh
6*	1.8.2vz	Positive active energy (A+) in tariff T2 - last completed month	3	kWh
7*	2.8.1 vz	Negative active energy (A-) in tariff T1 - last completed month	3	kWh
8*	2.8.2vz	Negative active energy (A-) in tariff T2 - last completed month	3	kWh
9*	3.8.1 vz	Positive reactive energy (R+) in tariff T1 - last completed month	3	kWh
10*	3.8.2vz	Positive reactive energy (R+) in tariff T2 - last completed month	3	kWh
11*	4.8.1 vz	Negative reactive energy (R-) in tariff T1 - last completed month	3	kWh
12*	4.8.2vz	Negative reactive energy (R-) in tariff T2 - last completed month	3	kWh
13, 14	1.6.1vz	Positive active power maximum demand ($P_{\max+}$) with Time stamp in tariff T1 - last completed month	4	kW
15, 16	1.6.2vz	Positive active power maximum demand ($P_{\max+}$) with Time stamp in tariff T2 - last completed month	4	kW
17*	31.7.0	Instantaneous current (I) in phase L1	3	A
18*	32.7.0	Instantaneous voltage (U) in phase L1	3	V
19*	33.7.0	Instantaneous power factor($\cos \varphi$) L1	3	
20*	51.7.0	Instantaneous current (I) in phase L2	3	A
21*	52.7.0	Instantaneous voltage (U) in phase L2	3	V
22*	53.7.0	Instantaneous power factor($\cos \varphi$) L2	3	
23*	14.7.0	Frequency	3	Hz
24*	71.7.0	Instantaneous current (I) in phase L3	3	A
25*	72.7.0	Instantaneous voltage (U) in phase L3	3	V
26*	73.7.0	Instantaneous power factor($\cos \varphi$) L3	3	
27*	81.7.1	Instantaneous phase angle U1-U2	3	
28*	81.7.2	Instantaneous phase angle U1-U3	3	
29*	81.7.4	Instantaneous phase angle U1-I1	3	
30*	81.7.5	Instantaneous phase angle U1-I2	3	
31*	81.7.6	Instantaneous phase angle U1-I3	3	
32*	0.8.0	Measurement period 1 (integration period)	3	s
33*	1.7.0	Positive active instantaneous power (P+)	3	kW
34*	21.7.0	Positive active instantaneous power (P+) in phase L1	3	kW
35*	41.7.0	Positive active instantaneous power (P+) in phase L2	3	kW
36*	61.7.0	Positive active instantaneous power (P+) in phase L3	3	kW
37*	2.7.0	Negative active instantaneous power (P-)	3	kW
38*	22.7.0	Negative active instantaneous power (P-) in phase L1	3	kW
39*	42.7.0	Negative active instantaneous power (P-) in phase L2	3	kW
40*	62.7.0	Negative active instantaneous power (P-) in phase L3	3	kW
41*	3.7.0	Positive reactive instantaneous power (P+)	3	kW

42*	23.7.0	Positive reactive instantaneous power (P+) in phase L1	3	kW
43*	43.7.0	Positive reactive instantaneous power (P+) in phase L2	3	kW
44*	63.7.0	Positive reactive instantaneous power (P+) in phase L3	3	kW
45*	4.7.0	Negative reactive instantaneous power (P-)	3	kW
46*	24.7.0	Negative reactive instantaneous power (P-) in phase L1	3	kW
47*	44.7.0	Negative reactive instantaneous power (P-) in phase L2	3	kW
48*	64.7.0	Negative reactive instantaneous power (P-) in phase L3	3	kW
37*	2.7.0	Negative active instantaneous power (P-)	3	kW
38*	22.7.0	Negative active instantaneous power (P-) in phase L1	3	kW
39*	42.7.0	Negative active instantaneous power (P-) in phase L2	3	kW
40*	62.7.0	Negative active instantaneous power (P-) in phase L3	3	kW
24	61.7.0	Positive active instantaneous power (P+) in phase L3	3	kW

***Press on LIST Key for list recorder data for particular month**

****Press on MENU key for scrolling down the monthly data list**

Scrolling down the monthly data list, button-press on the MENU for the last month billing data leads to information on monthly consumption for the month-2. Successive button-press of the LIST gives an overview of the data recorded for that particular month, whereas pressing MENU moves to the next menu to display the data for the month-3. Data list overview comes to an end upon reaching data for the last (twelfth) month recorded.

4.2.3. Test mode

There are two test modes implemented; one for meter hardware validation and the other used in the process of verification of metrological characteristics of the meter. Position of the terminal block cover determines the test mode status.

If the terminal cover is placed on (normal functioning of the meter, meter installed in the field) Test Mode allows meter hardware validation. The test implies display check first, all display segments are turned on to run display check. Then, the meter hardware validation follows and the error message is being displayed reading out the Error Code status (memory integrity, measurement fault—exceeding voltage or current measurement range, theft attempt, strong magnetic field influence). This is followed by battery status check and in case of any fault detected, the corresponding Error Code appears on the display. Next, the validity of memory and metrology system is checked. Error code if exist is displayed.

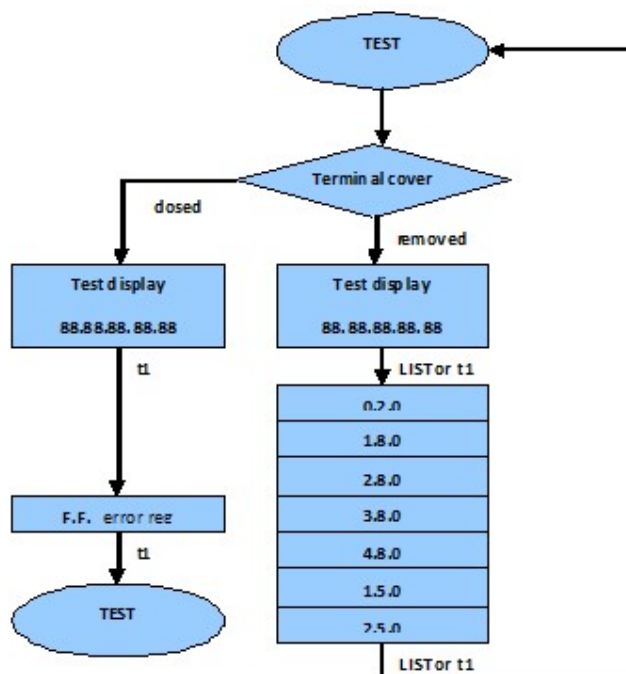


Figure 4.4 Display navigation diagram – test mode

In case of terminal cover missing (meter in laboratory or authorized person on the field), button-press of the LIST enables entering the Test Mode for metrological characteristics check. In this mode, the display shows energy registers as shown in the Figure 4.4, with increased accuracy (one more decimal point) as shown in Table 4.5.

Table 4.5

	INTEGERS	DECIMAL
1.8.0	5	3
2.8.0	5	3
3.8.0	5	3
4.8.0	5	3
1.5.0	2	3
2.5.0	2	3

Next succeeded button-presses of the LIST allows to preview values of this registers. After 20 seconds, if no other action, the meter display returns to automatic mode.

The meter self-diagnostics is run in case of:

- connection meter to the grid,
- return of a power supply,
- meter software update (when is possible and allowed),
- request from an authorized person with proper equipment (portable devices with an appropriate software).

5. Additional meter functions

5.1. Profiles of measured and registered values

The meter records and stores 5 data profiles:

- Billing profile –profile of monthly values of billing registers
- Load profile with recording period 1 - load profile
- Load profile with recording period 2 - consumption profile
- Load profile with recording period 3 - daily register values
- Load profile measured value - power quality

Table 5.1. *Electricity data profile objects*

Type	Object / Attr	Class Id	OBIS
Abstract objects - Billing period reset	Data of billing period 1	7	0-0:98.1.0.255
Electricity related objects - Profiles	Load profile with period 1 - load profile	7	1-0:99.1.0.255
Electricity related objects - Profiles	Load profile with period 2 - consumption profile	7	1-0:99.2.0.255
EWG	Load profile with period 3 - daily register values	7	1-0:99.3.0.255
EWG	Load profile measured value - power quality	7	1-0:99.2.1.255
Abstract objects - Billing period reset	Predefined Scripts - MDI reset / end of billing period	9	0-0:10.0.1.255
Abstract objects - Billing period reset	End of billing period	22	0-0:15.0.0.255
EWG	Status register 1	1	0-0:96.10.1.255
EWG	Status register 2	1	0-0:96.10.2.255
EWG	Status register 4	1	0-0:96.10.4.255

5.1.1. Billing profile

Billing data (active and reactive imported and exported energy and maximum active power demand with date and time of supply, registered according to tariffs) are stored for the last 24 accounting periods (typically 24 months). Billing profile can record values of maximum current per phase as well as maximum and minimum phase voltage with time stamp. Value is stored in attribute 2 and time and date of occurrence in attribute 5 of class 4.

5.1.2. Load profile with recording period 1 – load profile

Active power maximum demand values or energy register for all tariffs with time stamp and meter status are stored in load profile with recording period of 15 minutes. This is default value and recording period is changeable parameter (available 1, 5, 15, 30, 60 minutes). The memory storage capacity allows 5760 records in total with 10 channels for this profile.

5.1.3. Load profile with recording period 2 – consumption profile

Active and reactive energy registers (according to tariffs) with time stamp and meter status are stored in load profile with recording period of one hour. This is default value and recording period is changeable parameter. The memory storage capacity allows 5760 records in total with 10 channels for this profile.

5.1.4. Load profile with recording period 3 - daily register values

Active and reactive energy registers (according to tariffs) with time stamp and meter status are stored in load profile with recording period of 24 hours. This is default value and recording period is changeable parameter. The memory storage capacity allows 1000 records in total with 10 channels for this profile.

5.1.5. Load profile power quality (measured value)

Measured Value Profile records and registers voltage or current values - in all three phases. Initially voltage is set as the value for storing. Storage activation time is programmable (15 min. default). Storage capacity is maximum 1000 records. In addition to the values recorded, corresponding time stamps are registered as well.

5.2. Events and Event logs

Events are generated by the meter itself or by its environment. All these events are logged in several event logs. Every event has a unique code to identify the action, which has triggered it. Every event is assigned to one event log (event filter) and it is only stored there.

Six types of logs are implemented in the meter:

- Standard event log 1000 records
- Power quality log 1000 records
- Integrity violation log 1000 records
- Disconnecter control log 1000 records
- Communication log 1000 records
- Power failure log 1000 records

Table 5.2. Logs

Type	Object / Attr	Class Id	OBIS
Abstract objects - Errors & Alarms- Event logs	Standard Event Log	7	0-0:99.98.0.255
Electricity related objects - PQ- monitored values	Power Quality Log	7	0-0:99.98.4.255
Abstract objects - Errors & Alarms- Event logs	Fraud Detection Log	7	0-0:99.98.1.255
Abstract objects - Disconnecter- Load mgmt- Supervision	Disconnecter Control Log	7	0-0:99.98.2.255
EWG	Communication Log	7	0-0:99.98.5.255
Electricity related objects - PQ- monitored values	Power Failure Event Log	7	1-0:99.97.0.255

All logs except the **Power failure event log** have the same basic structure (timestamp - time of the occurrence of the event and event code).

5.2.1. Standard Event Log

Standard Event Log contains event codes with time stamps for following events:

- Power down
- Power up
- setting parameter for daylight saving time function (DST)
- setting up a new tariff system (calendar)
- time setting
- real time clock (RTC) error
- battery low voltage
- error register cleared
- alarm register cleared
- load profile cleared
- memory fault
- measuring system error
- new firmware loaded (if available)
- new firmware activated (if available)
- One or more parameters changed
- Global key(s) changed

Standard Event log has memory storage capacity for 1000 records

5.2.2. Power quality log (sag and swell)

The meter registers the event of occurrence of overvoltage and undervoltage per phase as well as their termination. Overvoltage and undervoltage thresholds are programmable with the initial values:

- overvoltage > 15% Un
- undervoltage < 20% Un
- missing voltage < 50% Un

The meter detects the undervoltage (sag), overvoltage(swell) and missing voltage in all phases. The threshold values of under voltage and over voltage are stored in the following COSEM objects and can be set/adjust locally or remotely:

Threshold for UnderVoltage (sags) (1-0:12.31.0.255);

Threshold for OverVoltage (swells) (1-0:12.35.0.255);

Threshold for Missing voltage (1-0:12.39.0.255);

The under/over voltage will not be recorded unless they continue for equal or greater than the time set threshold object. **Time threshold for voltage sag/swell** represents the limit between short and long voltage sag event.

Time thresholds adjustable by the following parameters:

Time Threshold for Under Voltage (1-0:12.43.0.255);

Time Threshold for Over Voltage (1-0:12.44.0.255);

Time Threshold for Missing voltage(1-0:12.45.0.255);

The event of occurrence of over/undervoltage is recorded in **PowerQualityLog** with time stamp. Power quality log has memory storage capacity for 1000 records.

5.2.3. Integrity violation log

The meter detects, records and stores unauthorised integrity violation events such as:

- terminal cover being opened
- meter cover being opened
- presence of a strong magnetic field in the vicinity of the meter > 200mT
- current reversal
- reply attack
- Decryption or authentication failure (n time failure)
- Association authentication failure (n time failed authentication)
- strong HF electromagnetic field

IntegrityViolationLog stores event code and time stamp of integrity violation event, and has storage capacity of 1000 records.

Opening the meter housing is detected even if the meter is disconnected from the grid. Event code for this kind of violation recorded in **IntegrityViolationLog** can be erased or reset in the authorised laboratory only.

Records for other event codes can be erased or reset only if the meter operates in Automatic Meter Reading system, following proper procedure.

5.2.4. Power failure

The meter registers the occurrence of supply interruption comply to EN50160 standard. There are two types of supply interruptions:

- short-term – in case of duration of interruption is less than 3 minutes
- long-term – in case of duration of interruption is more than 3 minutes

Each occurrence of supply interruption event is recorded in **PowerFailure Event Log(1-0:99.97.0.255)**.

5.2.4.1 Power failure log

The power failure event log contains all events related to long power outages. It stores the time stamp, duration of long power failures in any phase (where the time stamp represents the end of power failure).

Each entry recorded in Power Failure Event Log contains the following information about power failure events:

Time of power return after long power failure;

Duration of last long power failure in any phase (0-0:96.7.19.255 attribut 2)

Power failure event log has memory storage capacity for 1000 records.

5.2.4.2 Power failure objects

The value set in the object **Time threshold for long power failure** (0-0:96.7.20.255) represents the limit between short and long power failure events. Default value 180s.

In case of short-term supply interruption event occurrence, *Number_of_short-term_supply_interruption* registers (for affected phase and "in any of three phases"), incremented. As well, *Short-term_supply_interruption_duration* registers (for affected phase and "in any of three phases") are updated.

In case of long-term supply interruption event occurrence, *Number_of_long-term_supply_interruption* registers (for affected phase and "in any of three phases"), incremented. As well, *Long-term_supply_interruption_duration* registers (for affected phase and "in any of three phases") are updated.

PowerFailure Event Log contains time of occurrence and duration of supply interruptions in any phase.

Table 5.3. PowerFailure Event Log objects

Type	Object / Attr	Class Id	OBIS
EWG	No. of long power failures; in all three phases	1	0-0:96.7.5.255
EWG	No. of long power failures; in phase L1	1	0-0:96.7.6.255
EWG	No. of long power failures; in phase L2	1	0-0:96.7.7.255
EWG	No. of long power failures; in phase L3	1	0-0:96.7.8.255
Electricity related objects - PQ- monitored values	Number of long power failures in any phase	1	0-0:96.7.9.255
Electricity related objects - PQ- monitored values	Number of power failures in any phase	1	0-0:96.7.21.255
EWG	Man. Spec. / No. of short failures in ph1	1	0-0:96.7.129.255
EWG	Man. Spec. / No. Of short failures in ph2	1	0-0:96.7.131.255
EWG	Man. Spec. / No. of short failures in ph3	1	0-0:96.7.133.255
EWG	Duration of long power failures; in all three phases	3	0-0:96.7.15.255
EWG	Duration of long power failures; in phase L1	3	0-0:96.7.16.255
EWG	Duration of long power failures; in phase L2	3	0-0:96.7.17.255
EWG	Duration of long power failures; in phase L3	3	0-0:96.7.18.255
Electricity related objects - PQ- monitored values	Duration of last long power failure in any phase	3	0-0:96.7.19.255
Electricity related objects - PQ- monitored values	Time threshold for long power failure	3	0-0:96.7.20.255
EWG	Man. Spec. / Time for short power failure ph1	3	0-0:96.7.130.255
EWG	Man. Spec. / Time for short power failure ph2	3	0-0:96.7.132.255
EWG	Man. Spec. / Time for short power failure ph3	3	0-0:96.7.134.255

5.2.5. Disconnector Control Log

Disconnector Control Log contains event codes with time stamps for following events:

- Disconnector ready for manual reconnection
- Manual disconnection
- Manual connection
- Remote disconnection
- Remote connection
- Local disconnection
- Limiter threshold exceeded
- Limiter threshold ok

- Limiter threshold changed
- Disconnect/Reconnect failure
- Local reconnection

5.2.6. Communication Log / Event log

Communication Log contains event codes with time stamps for following events

- No connection timeout
- Modem Initialization failure
- SIM Card failure
- SIM Card ok
- GSM registration failure
- GPRS registration failure
- PDP context established
- PDP context destroyed
- PDP context failure
- Modem SW reset
- Modem HW reset
- GSM outgoing connection
- GSM incoming connection
- GSM hang-up
- Diagnostic failure
- User initialization failure
- Signal quality low
- Auto Answer Number of calls exceeded
- Local communication attempt

5.3. Alarms

Some of the predefined events, when occurred in the meter, trigger alarms and corresponding flag (bit) in Alarm Registers is set. Alarm register is a 32-bit value of all active and inactive alarms. It is possible to mask unwanted alarms through the alarm filter.

Table 5.4. Alarm registers

Type	Object / Attr	Class Id	OBIS
Abstract objects - Errors & Alarms- Event logs	Alarm Register 1	1	0-0:97.98.0.255
Abstract objects - Errors & Alarms- Event logs	Alarm Register 2	1	0-0:97.98.1.255
Abstract objects - Errors & Alarms- Event logs	Alarm Descriptor 1	1	0-0:97.98.20.255
Abstract objects - Errors & Alarms- Event logs	Alarm Descriptor 2	1	0-0:97.98.21.255
Abstract objects - Errors & Alarms- Event logs	Alarm Filter 1	1	0-0:97.98.10.255
Abstract objects - Errors & Alarms- Event logs	Alarm Filter 2	1	0-0:97.98.11.255
Abstract objects - Errors & Alarms- Event logs	Alarm Monitor 1	21	0-0:16.1.0.255
Abstract objects - Errors & Alarms- Event logs	Alarm Monitor 2	21	0-0:16.1.1.255

5.3.1. Alarm reporting process


Figure 5.1 shows the different entities involved in the alarming process. Alarm registers contains all information on the “cause of the alarm”. Specific bits of Alarm Registers may be internally reset if the “cause of the alarm” has disappeared. Alternatively, all bits may be externally reset by the client. In the latter case those bits for which the “cause of alarm” still exists will be set to 1 again and an alarm will be issued.

The Alarm Descriptors have exactly the same structure as the Alarm Registers. Whenever a bit in the Alarm Registers changes from 0 to 1, then the corresponding bit of the Alarm Descriptors (AD) is set to 1. Resetting the Alarm Registers does not affect the Alarm Descriptors. The set bits of the AD must be reset explicitly by the HES.

The Alarm Descriptors are sent to the HES using the Data-Notification service triggered by the corresponding Alarm Monitor. Alarm Monitor Threshold value is set to zero. Therefore the Alarm Monitor action is invoked when any of the bits in the Alarm Descriptors value changes from 0 to 1.

In order to acknowledge the reception of the Alarm the HES has to reset the Alarm Descriptors. Upon reception of this the meter clears the corresponding bits in the Alarm Descriptors.

In order to re-enable the alarm reporting process the HES must reset the reported bits in the Alarm Register. This can only be done by setting all the bits of the Alarm Registers to 0. Prior to this action the HES must read the latest value of the Alarm Register.

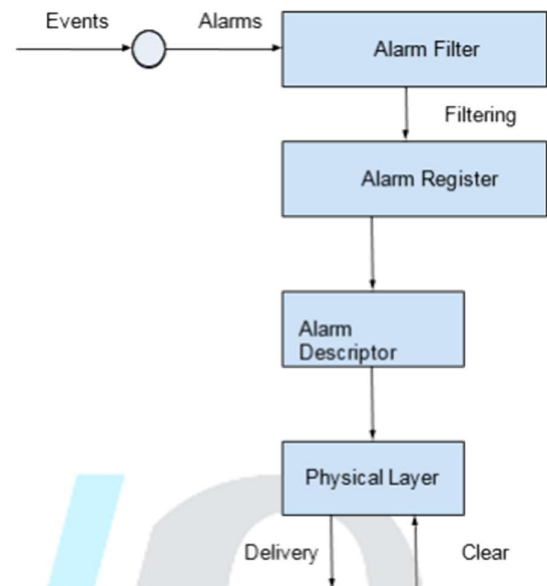

6. Disconnect control – Load Switching Module

Disconnecter is used for remote disconnection and reconnection of electric network to individual customers. The basic 100A relay allows remote, local (by a function of the meter, e.g. limiter) and manual (by push button) types of control. The remote control can be carried out by address command for a meter and by group command for a group of meters.

Disconnect and reconnect can be requested:

- Remotely, via a communication channel: remote disconnect, remote reconnect,
- Manually, using MENU and LIST keys : manual reconnect,
- Locally, by limiter: local disconnect, local reconnect.

Disconnect physical state takes two values:

- Connected (TRUE) - Customer is connected to the network
- Disconnected (FALSE) - Customer is disconnected from the network

Disconnect logical state takes three values:

- Connected – (1),
- Disconnected – (0),

Ready for reconnection (disconnected and ready for reconnection) – (2).

The following objects allow supporting the Electricity device connection/disconnection management:

Table 6.1. *Disconnecter control object*

Description	Class ID	Logical name
Disconnect control	70	0-0:96.3.10.255
Disconnect control script table	9	0-0:10.0.106.255
Disconnect control scheduler	22	0-0:15.0.1.255
Disconnect event object	1	0-0:96.11.2.255
Disconnect control logbook	7	0-0:99.98.2.255
Limiter	71	0-0:17.0.0.255
Instantaneous current active import	3	1-0:1.7.0.255
Average current active import	5	1-0:1.24.0.255
Average total demand	3	1-0:15.24.0.255
Instantaneous total current	3	1-0:90.7.0.255
Sliding average current L1	5	1-0:31.4.0.255
Sliding average current L2	5	1-0:51.4.0.255
Sliding average current L3	5	1-0:71.4.0.255
Supervision monitor L1	21	1-0:31.4.0.255
Supervision monitor L2	21	1-0:51.4.0.255
Supervision monitor L3	21	1-0:71.4.0.255
Active energy import cumulative	3	1-0:1.8.0.255

6.1. Object disconnect control

Object disconnect control **class_id:70** OBIS code : **0-0:96.3.10.255** controls all the connection and disconnection.

Object settings are:

- Output state
- Control state
- Control mode

6.1.1. Output State

Disconnect Output State shows the actual physical state of the disconnect unit.

FALSE – Open – Customer is disconnected from the network - (0),
TRUE – Closed – Customer is connected to the network - (1).

6.1.2. Control State

Control State defines internal logical state of the disconnect unit. Possible control states are:

Disconnected – Customer is disconnected from the network - (0),
Connected – Customer is connected to the network - (1),

Ready for reconnection – Customer is disconnected from the network – (2) and on the display appears message **ConnEct**.

When disconnector is in Ready For Reconnection control state, it is possible to perform manual connect on the meter by holding the **Menu and List** keys until **ConnEct** disappears from the display.

6.1.3. Control Mode

Defines available transitions in Disconnect control class.

Table 6.1. Disconnecter control class

Control Mode	Transition	Description
0	None.	The disconnect control object is always in „connected“ state
1	Disconnection	Remote (b, c) Manual (f) – Press and hold MENU and LIST key till “ConnEct” appears (disconnecter change Control state to “Ready for reconnection”) Local (g)
	Reconnection	Remote (d) Manual (e) – Press and hold MENU and LIST key till “ConnEct” disappears (disconnecter is in Control state “Connected”)
2	Disconnection	Remote (b, c) Manual (f) – Press and hold MENU and LIST key till “ConnEct” appears (disconnecter change Control state to “Ready for reconnection”) Local (g)
	Reconnection	Remote (a) Manual (e) – Press and hold MENU and LIST key till “ConnEct” disappears (disconnecter is in Control state “Connected”)
3	Disconnection	Remote (b, c) Local (g)
	Reconnection	Remote (d) Manual (e)
4	Disconnection	Remote (b, c) Local (g)
	Reconnection	Remote (a) Manual (e)– Press and hold MENU and LIST key till “ConnEct” disappears (disconnecter is in Control state “Connected”)
5	Disconnection	Remote (b, c) Manual (f) – Press and hold MENU and LIST key till “ConnEct” appears (disconnecter change Control state to “Ready for reconnection”) Local (g)
	Reconnection	Remote (d) Manual (e) – Press and hold MENU and LIST key till “ConnEct” disappears (disconnecter is in Control state “Connected”) Local (h)
6	Disconnection	Remote (b, c) Local (g)
	Reconnection	Remote (d) Manual (e) – Press and hold MENU and LIST key till “ConnEct” disappears (disconnecter is in Control state “Connected”) Local (h)

Depending on the mode selected, manual reconnection is possible by pressing the **Menu and List** keys.

Manual reconnection (control modes>0): On display shows **ConnEct**. Press the **Menu and List** keys (for a few seconds) and then release the key.

Manual disconnection (control modes: 1, 2 or 5): Press and hold MENU and LIST key till “ConnEct” appears.

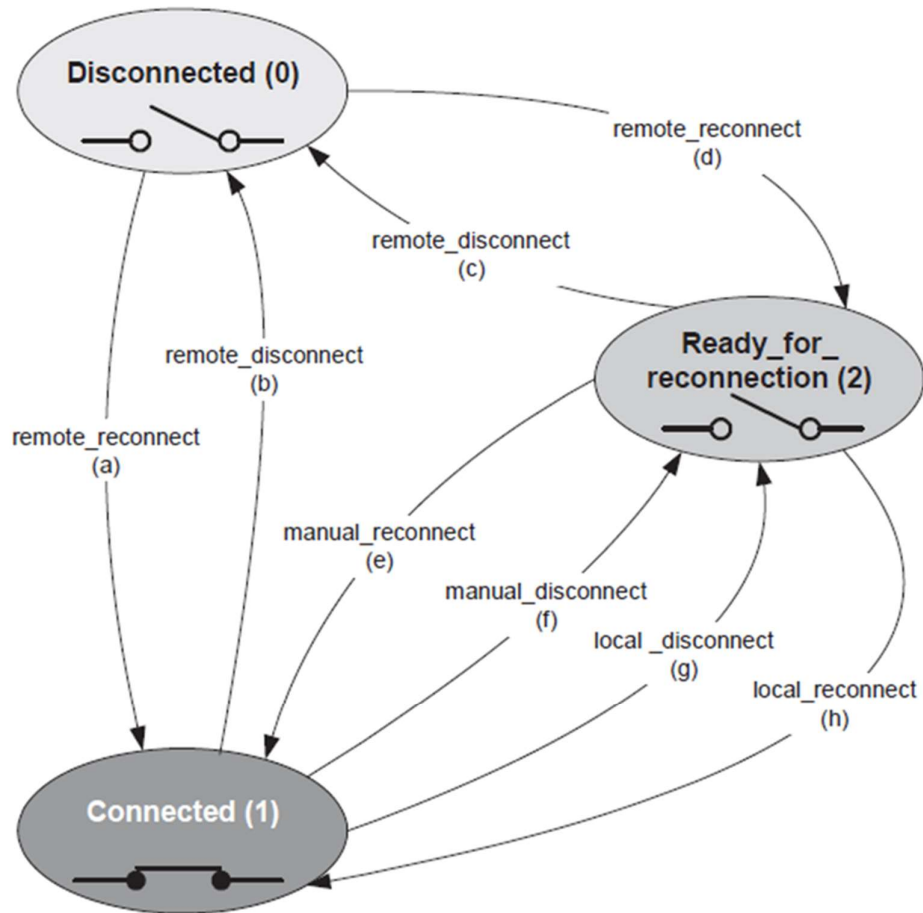


Figure 6.1 *Disconnector control*

6.1.4. Method Description

There are two methods for the disconnect control class:

- Remote disconnect forces the disconnecter into „disconnected“ state if remote disconnection is enabled (control mode > 0) and flag SC on display is ON.
- Remote reconnect forces the disconnecter into state:

„connected“ in control mode = 2,4.

„ready for reconnection“ manual reconnect in control mode = 1,3,5,6

- Manual disconnect forces the disconnecter into „disconnected“ state:

by pressing the **Menu and List** keys for 20 sec in control mode = 1,2,5.

6.2. Disconnect control scheduler (Class_ID 22)

The schedule control of internal relay will be handled by COSEM objects “Disconnect/Reconnect Control Scheduler” (22, 0-0:15.0.1.255). This schedule can be used for both disconnection and reconnection of internal relay.

The schedule (from Class ID: 22) is single action schedule. The Scheduler object (Disconnect or Reconnect) call “Disconnecter Script Table” COSEM object (9, 0-0:10.0.106.255) to make an action (connect/disconnect). The following parameters shall be specified in Scheduler object to fulfill the task:

Executed Script (Action);

Execution Time;

6.3. Disconnecter script table (Class_ID 9)

The disconnecter script table contains the scripts as follows:

Script identifier	Action
1	execute method “remote_disconnect(0)”
2	execute method “remote_reconnect(0)”


Script 1 and script 2:

With the help of the single action schedule the remote operation of the disconnecter can be executed at a specific, delayed time instance. In this case the actual dis/re-connection (triggered by the single action schedule via script 1 or 2) is still interpreted as a remote operation.

The action service to method 1 “execute(data)” of the Disconnect script table object is not allowed for any remote client.

Table 6.2. Disconnecter script table Class_ID 9 0-0:10.0.106.255

	Disconnecter script table	Class_ID 9 Ver 0	0-0:10.0.106.255	
1	Logical_name	octet_string[6]	"00000A006AFF"	
2	Script	array[4](script9)	{ {1,{{2,70,0-0:96.3.10.255,1,0}}}, //execute remote disconnect {2,{{2,70,0-0:96.3.10.255,2,0}}}, //execute remote connect }	connect and disconnect scripts, 1 and 2 model remote disconnection and connection
1	execute	long_unsigned		Executes the script specified in parameter data. If data matches one of the script_identifiers in the script table, then the corresponding action_specification is executed. No direct method call possible via remote communication

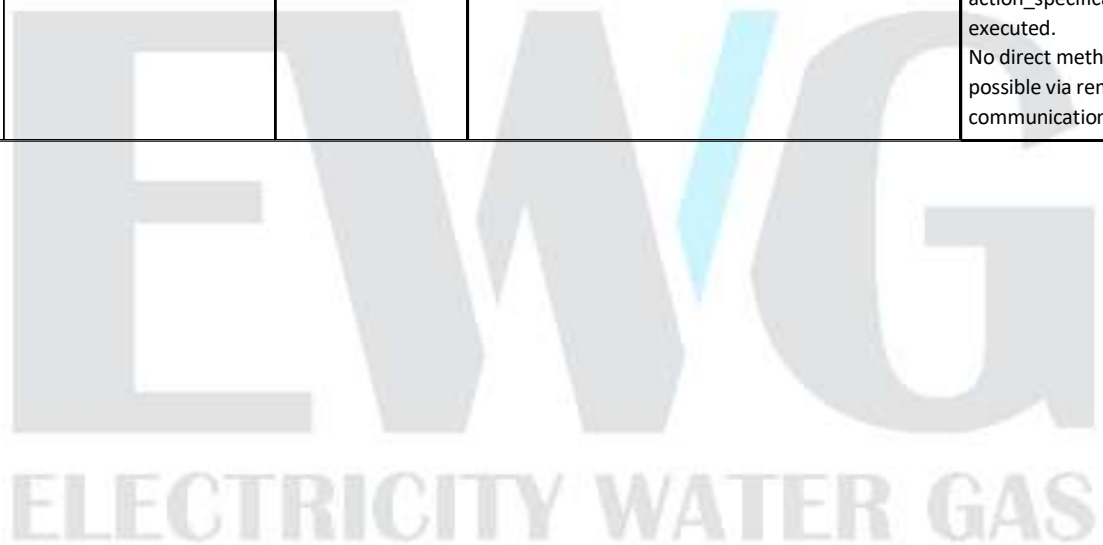

7. Limiter Interface Class (class_id:71)

The limiter control is intended to limit the demand at a defined value (that has been specified by utility). The limiter issues command to disconnect the internal relay (contactor) when the monitored value crosses the threshold value and stay for specific time duration. The limiter control is handled by COSEM object "Limiter" **{71,0-0:17.0.0.255}**. The limiter control acts as internal process and change the relay state from connected to ready for reconnection and vice versa.

Two disconnecting profiles are defined in meter as follows:

- Normal Operation;
- Emergency Operation;

Two separate threshold values are provided for normal and emergency operations. The provisions are provided in central system (software) to select the Limiter in Normal Operation monitored values and to specify the thresholds.

7.1. Limiter in Normal Operation

The role of the limiter object is to act on the disconnecter when the monitored quantity exceeds the active threshold. A disconnection originated by the limiter is a local disconnection which does not need the HES contribution for reconnection.

Table 7.1. Limiter script table

	Limiter	Class_ID 71 ver 0	0-0:17.0.0.255	Description
1	logical_name	octet_string[6]	"0000110000FF"	
2	monitored_value	value_definition	{5, 1-0:1.24.0.255, 2}	Average import power
3	threshold_active	threshold		Limit active
4	threshold_normal	threshold		Limit normal
5	threshold_emergency	threshold		Limit emergency
6	min_over_threshold_duration	double_long_unsigned	180	3 min
7	min_under_threshold_duration	double_long_unsigned	180	3 min
8	emergency_profile	emergency_profile_type		emergency_profile ::= structure emergency_profile_id: long-unsigned, emergency_activation_time: octet-string, emergency_duration: double-long-unsigned
9	emergency_profile_group_id_list	array		emergency_profile_group_id-list: array emergency_profile_group_id emergency_profile_group_id: long-unsigned
10	emergency_profile_active	boolean		True - emergency profile active False - emergency profile not active
11	actions	action_set	choice({ {0-0:10.0.106.255,1} , {0-0:10.0.106.255,2})	Defines the scripts to be executed when the monitored value crosses the threshold for minimal duration time.

The measured quantities which may be used by Limiter instance for the activation of the Disconnect control object are:

Instantaneous total current	Class Id 3	Logical name 1-0:90.7.0.255
Average current active import	Class Id 5	Logical name 1-0:1.24.0.255
Average total power	Class Id 5	Logical name 1-0:15.24.0.255

Description Limiter {71,0-0:17.0.0.255 , 2}

Attribute2 = monitored_value

monitored_value = sliding demand

- Average import power (+A): {5, 1-0:1.24.0.255, 2}
- Average Total Power (|+A|+|-A|): {5,1-0:15.24.0.255, 2}

or

monitored_value = Instantaneous values

- Instantaneous total current {3, 1-0:90.7.0.255, 2}

Whenever monitored_value for more than *min_over_threshold_duration* (T1 second) exceeds from the value of *threshold_normal/threshold emergency*, the internal relay should be triggered based on the value of attribute 11 (action):

Action=Limiter {71,0-0:17.0.0.255 , 11}

Maximum value for *threshold_normal/threshold emergency* for demand should be limited to:

Max_demand_threshold (normal/emergency) < $I_{max} \cdot V_{nom}$

If the internal relay is triggered by exceeding the demand (current) limitation it should keep its state, then if the *monitored_value* goes down the *threshold_active* and stays there for the *in_under_threshold_duration* (T2) seconds, output state of relay should be updated based on *the actions* defined in (attribute 11).

Electronic energy meters with a build-in load switch can be programmed for a maximum load. If a consumer exceeds the limit, he will be disconnected.

8. Tariff control

The meter allows energy consumption registration in up to four tariffs.

There is a possibility of either internal or external tariff control. Internal tariff control uses integrated real time clock (RTC). External tariff device is used for external tariff control.

In case of external tariff control is used, external tariff device signal output is connected on the meter's auxiliary terminal labelled 51. In that case 2 tariff system is applied.

On the other hand, 4 tariff system needs one more signal output from external tariff device to be connected on the meter's auxiliary terminal labelled 52.

Selection of tariffs, using external tariff inputs, is done in the following scheme:

Table 8.1. *Four tariff system external control scheme*

	51	52
T1	0	0
T2	230 V	0
T3	0	230 V
T4	230 V	230 V

In case of using internal switch for tariff control a more complex structure involving time-of-use tariffs (TOU) shall be implemented for tariff register management:

- 4 seasons
- 4 week types
- 5 different days in a week
- 8 transition daily
- 10 different holydays

The active tariff is determined according to the tariff schedule and indicated by a flashing cursor on the display. The tariff schedule is determined by the energy supplier. On delivery, meters are initialized with agreed tariff system that suits the application of energy supplier. Changes in tariff system are made by using internal or external communication (hand-held terminal, PC, etc.) with appropriate software. All tariff system changes are password protected.

Table 8.2. *Tariff objects*

Type	Object / Attr	Class Id	OBIS
Abstract objects - Time related issues	Activity Calendar	20	0-0:13.0.0.255
Abstract objects - Time related issues	Tariffication script table	9	0-0:10.0.100.255
Abstract objects - Time related issues	Special Days Table	11	0-0:11.0.0.255
Abstract objects - Time related issues	Register activation	6	0-0:14.0.1.255
Abstract objects - ID's & Control information	Currently active tariff; #1	1	0-0:96.14.0.255

9. Software update

The meters family EWGE31x and EWGE31xAxRx support firmware update.

The meter stores information about actual firmware version, as well as firmware versions of communication modem and in-home display devices (HAN) if any.

Table 9.1. *Firmware objects*

Type	Object / Attr	Class Id	OBIS
Abstract objects - Firmware Upgrade	Active firmware version	1	1-0:0.2.0.255
Abstract objects - Firmware Upgrade	Active firmware version signature	1	1-0:0.2.8.255
Abstract objects - Firmware Upgrade	Active firmware version 1	1	1-1:0.2.0.255
Abstract objects - Firmware Upgrade	Active firmware version signature 1	1	1-1:0.2.8.255
Abstract objects - Firmware Upgrade	Image transfer activation scheduler	22	0-0:15.0.2.255
EWG	Image activation scheduler - Application	22	0-1:15.0.2.255
EWG	Image activation - Application	9	0-1:10.0.107.255
Abstract objects - Firmware Upgrade	Predefined Scripts - Image activation	9	0-0:10.0.107.255

The meter supports remote and local updating of the application firmware (ARM STM processor).

The metrological firmware is not changeable. The activation of the firmware starts only after the new firmware is completely downloaded to the meter by checking the firmware signature.

In the Standard event log, the counter writes firmware change events.

The meter records the event log for the firmware update in Standard event log.

The firmware upgrade process is done in four main steps (using firmware objects Table 9.1):

- Initial Phase;
- Image Transfer;
- Image Check;
- Image Activation;

The image- firmware activation is the last step of firmware upgrade process. The firmware activation will be done at time and date specified by central system via one of two following ways:

- Immediate Activation;
- Scheduled Activation;

The time and date of firmware activation is specified by execution time attribute of object Image activation scheduler.

10. Data transfer security

The meter supports three levels of data transfer security. Each type of the meter's data can be addressed to different association with different security level.

- not protected
- low level of security - passwords
- high level of security – ciphering

Ciphering - a symmetric key algorithm AES-GCM128 has been selected, as specified in NISTSP 800-38-D. It provides authenticated encryption to xDLMS APDUs.

For key transport, the AES key wrap algorithm has been selected.

Table 10.1. *Data transfer security objects*

Type	Object / Attr	Class Id	OBIS
Abstract objects - Association & Security	Security - Receive frame counter - unicast key	1	0-0:43.1.0.255
Abstract objects - Association & Security	Security - Receive frame counter - broadcast key	1	0-0:43.1.1.255
Abstract objects - Association & Security	Current association	15	0-0:40.0.0.255
Abstract objects - Association & Security	SAP Assignment	17	0-0:41.0.0.255
Abstract objects - Association & Security	Security setup	64	0-0:43.0.0.255

11. Meter marking

Label	Description	Meter label								
		no. of phases	connection	direction	current	class active	class reactive	modem	switch	processor
	EWG	E3	1	1	N3	AB	R20	C0	S	P
Number of measurement systems	one measurement system	E1								
	two measurement systems	E2								
	three measurement systems	E3								
Connection	direct connection		1							
	current transformer		2							
	voltage transformer		3							
	current and voltage transformers		4							
Energy direction	total active energy A			1						
	import/export active energy A+/A-			2						
Nominal (maximal) current	5(40) A				N1					
	5(60) A				N2					
	5(80) A				N3					
	10(40) A				N4					
	10(60) A				N5					
	10(80) A				N6					
	5(6) A				N7					
	5(10) A				N8					
	5(100) A				N9					
	10(100) A				N10					
Active energy accuracy class	0.2S					A02S				
	0.5S					AC				
	1					AB				
	2					AA				
Reactive energy accuracy class	2						R20			
	3						R30			
Internal modems	RS485 modul							C0		
	Celular modem							C1		
	PLC modem							C2		
Switch	Without switch								-	
	With internal switch								S	
Processor	ARM with F0									-
	ARM with G0									P

12. Packaging and Storage

The meter package implies a plastic bag with the warranty card enclosed. Transport package contains 12 pcs, each followed by the respective warranty card and instructions for handling and installation. Bulk package is accompanied with a packing list containing serial numbers of the meters, meter type and manufacturer's labels.

